





Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. C-BJ-3040

CBJ 3040

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating - 2 Hr	F Rating - 2 Hr
T Rating - 1-1/2 or 2 Hr (See Item 3)	FT Rating - 1-1/2 or 2 Hr (See Item 3)
L Rating At Ambient — Less Than 1 CFM/Device	FH Rating - 2 Hr
L Rating At 400 F — Less Than 1 CFM/Device	FTH Rating -1-1/2 or 2 Hr (See Item 3)
	L Rating At Ambient — Less Than 5.1 L/s/Device
	L Rating At 204 C — Less Than 5.1 L/s/Device

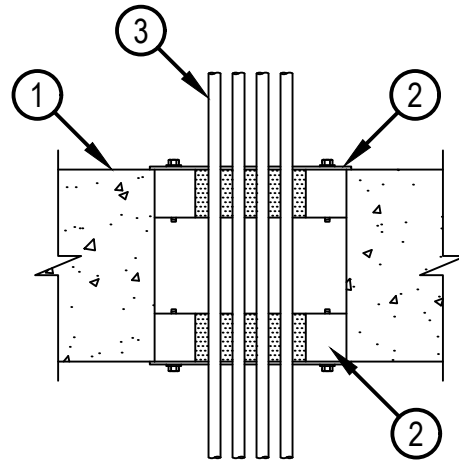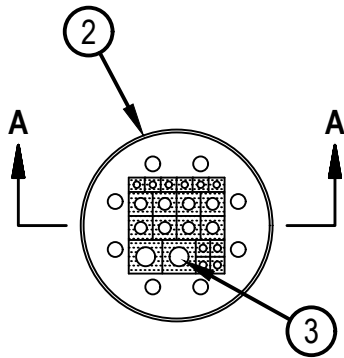

SECTION A-A

1. Floor or Wall Assembly — Min 8 in. (203 mm) thick reinforced normal weight (150 pcf or 2400 kg/m³) concrete. Max diam of opening is 8 in. (203 mm).
2. Firestop Device* — The circular firestop device consists of an elastomeric plug with metal trim, elastomeric cable modules and lubricant. The firestop device is intended to be friction fitted into openings flush with both surfaces of the floor assembly or wall assembly. After installation of the modules into the device, the nuts of the trim plate are tightened to compress the elastomeric plug and form an effective seal around the cables and within the opening. The device shall be installed in accordance with the accompanying installation instructions and shall include the components as described below.
 - A. CFS-T RR GS Plug Seal — CFS-T RR GS Plug Seal. Size range max RR 200.



Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
October 10, 2018

System No. C-BJ-3040

CBJ 3040

B. CFS-T Cable Modules — The rectangular annular space within the firestop device plug is completely filled with elastomeric cable modules, one specifically sized for the outer diameter of each cable penetrant. In areas within the opening with no penetrants, solid cable modules (solid cylindrical core of the unpenetrated module left in place) or filler modules can be used. The cable modules are installed in uniform rows within the device. The total number of modules required within the device is specified by Hilti based on the device size and cable diameters.

C. CFS-T LUB — Lubricant is applied to each cable module prior to installation within the device frame.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-T RR Plug Seal

3. Cables — Cables to be rigidly supported on both sides of floor or wall assembly. Any combination of the following types and sizes of copper conductor (unless otherwise noted) cables may be used, except that the total number of cables of types E, F and G below shall not exceed six (6). Within each firestop device, cables shall be used for a total visual cable fill of min 0 percent to max 100 percent (one cable in each cable module within the device).

A. Max RG 6/U coaxial cable with fluorinated ethylene insulation and jacketing.

B. Max 7/C No. 12 AWG copper conductor control cable with PVC or XLPE jacket and insulation.

C. Max 24 fiber optic cable with polyvinyl chloride (PVC) or polyethylene (PE) jacket and insulation having a max diam of 1/2 in. (13 mm).

D. Max 3/C with ground No. 8 AWG (or smaller) copper conductor NM cable (Romex) with PVC insulation and jacket.

E. Max 4/0 AWG 600V aluminum Type XHHW-2 ground cable with XLPE jacket and insulation.

F. Max 150 pair No. 24 AWG (or smaller) copper conductor telecommunication cable with polyvinyl chloride (PVC) jacketing and insulation.

G. Max 7/C with ground, 600 V, No. 10 AWG (or smaller) copper conductor, aluminum armor TECK 90 cable with XLPE insulation and PVC inner/outer jacket.

T, FT and FTH Ratings are 2 hr when cables A through D are used. T, FT and FTH Ratings are 1-1/2 hr when cables E through G are used.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
October 10, 2018

Page: 2 of 2