




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. F-A-1207

FA 1207

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 2 Hr	F Rating — 2 Hr
T Ratings — 1 and 2 Hr (See Item 4)	FT Ratings — 1 and 2 Hr (See Item 4)
L Rating At Ambient — 1 CFM/sq ft	FH Rating — 2 Hr
L Rating At 400°F — Less Than 1 CFM/sq ft	FTH Ratings — 1 and 2 Hr (See Item 4)
	L Rating At Ambient — 5.1 L/s/m ²
	L Rating At 204°C — Less Than 5.1 L/s/m ²

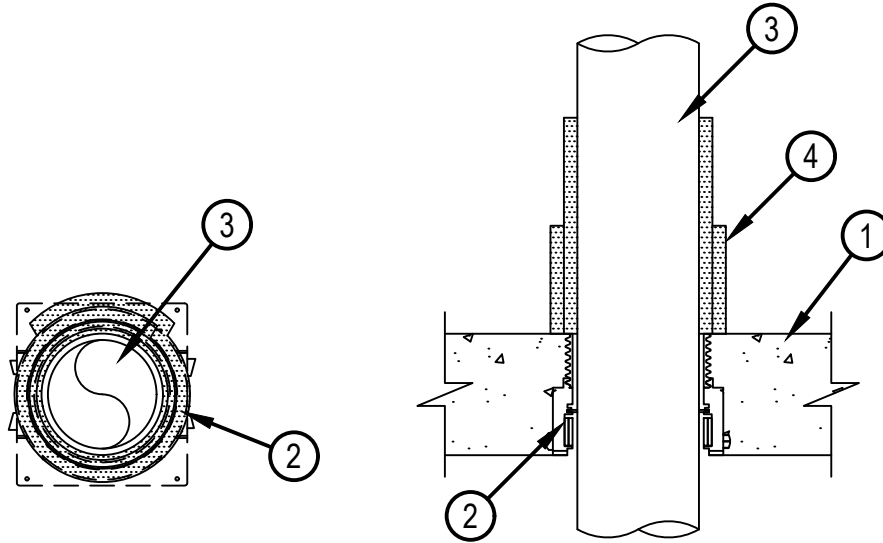

SECTION A-A

1. Floor Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. As an alternate, any min 2 hr fire rated D700, D800 or D900 Series Floor-Ceiling Design in the UL Fire Resistance Directory having a min 4-1/2 in. (114 mm) thickness of lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete topping over the steel deck may be used.
2. Firestop Device* — Cast in place firestop device permanently embedded during concrete placement or grouted in concrete floor assembly in accordance with accompanying installation instructions. Device sized to nom diam of penetrant. Device is to be trimmed flush with the top surface of the floor.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CP 680-M 2", CP 680-M 3", CP 680-M 4", CP 680-P 2", CP 680-P 3", CP 680-P 4", CP 680-PX 2", CP 680-PX 3" Cast-In Firestop Devices.
3. Through-Penetrant — One metallic pipe installed concentrically or eccentrically within opening. Penetrant to be rigidly supported on both sides of floor assembly. The following types and sizes of penetrants may be used:
 - A. Steel Pipe — Nom 4 in. (102 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
 - B. Iron Pipe — Nom 4 in. (102 mm) diam (or smaller) cast or ductile iron pipe.
 - C. Conduit — Nom 4 in. (102 mm) diam (or smaller) rigid steel conduit or nom 4 in. (102 mm) diam (or smaller) steel electrical metallic tubing.
4. Pipe Covering Material* — Nom 0.5 in. (12.7 mm) flexible sheet material. One layer of pipe covering shall be continuously wrapped around the penetrant, extending min 12 in. (305 mm) above the floor. For a 2 hr T, FT and FTH Rating, an additional layer of pipe covering shall be tightly wrapped around the first layer and extend min 6 in. (152 mm) above floor. All seams to overlap min 2 in. (51 mm) and to be sealed with FSK or foil tape.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFP-ES Endo-Shield

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
November 15, 2021