




Classified by Underwriters Laboratories, Inc. to UL 2079 and CAN/ULC-S115

System No. BW-S-0069

BWS 0069

ANSI/UL2079	CAN/ULC S115
Assembly Ratings — 1 and 2 Hr (See Item 2)	F Ratings — 1 and 2 Hr (See Item 2)
Nominal Joint Width — 3/4 in. (See Item 2)	FT Ratings — 1 and 2 Hr (See Item 2)
L Rating at Ambient — Less than 1 CFM/Lin Ft	FH Ratings — 1 and 2 Hr (See Item 2)
L Rating at 400°F — Less than 1 CFM/Lin Ft	FTH Ratings — 1 and 2 Hr (See Item 2)
	Nominal Joint Width — 19 mm (See Item 2)
	L Rating at Ambient — Less than 1.55 L/s/m
	L Rating at 204°C — Less than 1.55 L/s/m

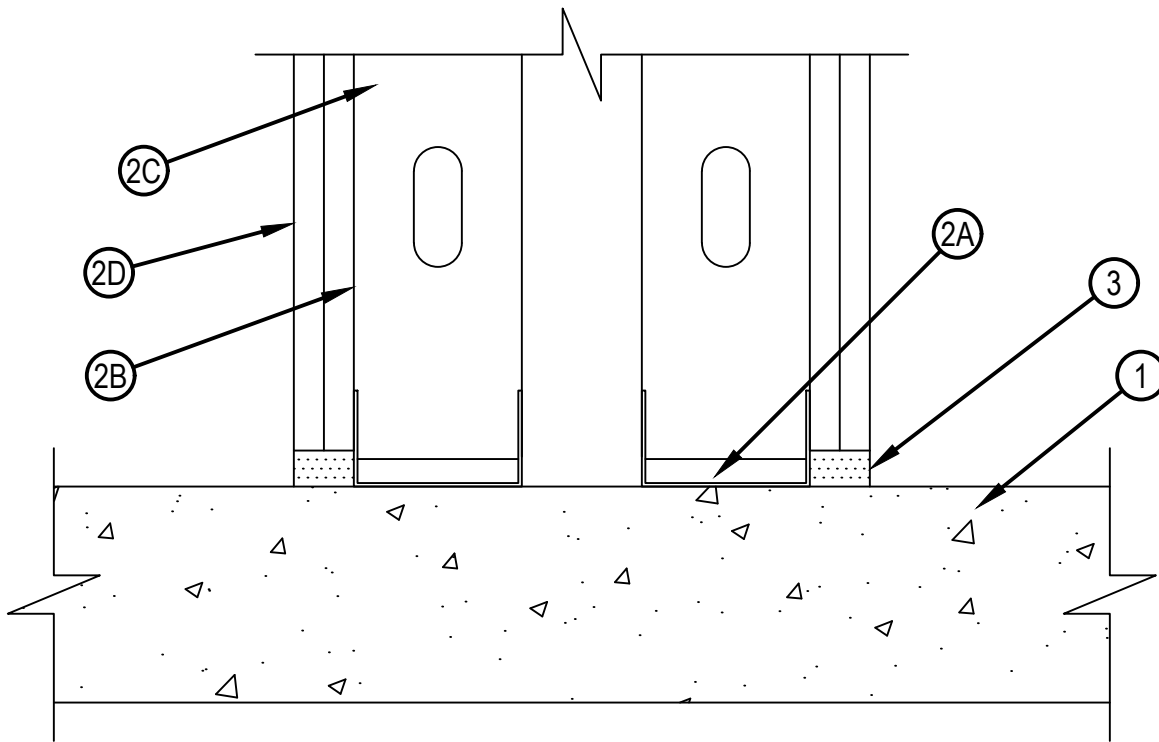

Reproduced by HILTI, Inc. Courtesy of Underwriters Laboratories, Inc. April 02, 2024

System No. BW-S-0069

BWS 0069

1. Floor Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor may also be constructed of any 6 in. (152 mm) thick UL Classified hollow-core Precast Concrete Units*.

See Precast Concrete Units category in the Fire Resistance Directory for names of manufactures.

1A — (Not Shown, Alternate) The fire-rated fluted steel floor unit/concrete floor assembly shall be constructed of the materials and in the manner described in the individual D700 or D900 Series Floor-Ceiling Design in the UL Fire Resistance Directory and shall include the following construction features:

A. Steel Floor and Form Units* — Max 3 in. (76 mm) deep galv steel fluted units.

B. Concrete — Min 2-1/2 in. (64 mm) thick reinforced concrete, as measured from the top plane of the floor units.

2. Wall Assembly — The 1 or 2 hr fire-rated gypsum board/stud chase (double stud) wall assembly shall be constructed of the materials and in the manner specified in the individual U400, V400 or W400 Series Wall in the UL Fire Resistance Directory. In addition, the wall may incorporate a head-of-wall joint system as specified in the HW Series Joint Systems in the UL Fire Resistance Directory. The wall shall include the following construction features:

A. Steel Floor Runners — Floor runners of wall assembly shall consist of min No. 25 gauge galv steel channels sized to accommodate steel studs (Item 2B). Floor runners to be provided with 1-1/4 in. (32 mm) flanges. Runners secured with steel fasteners spaced 24 in. (610 mm) OC.

B. Studs — Steel studs to be min 2-1/2 in. (89 mm) wide. Studs cut 1/2 to 3/4 in. (13 to 20 mm) less in length than assembly height with bottom nesting in, resting on and fastened to floor runner with sheet metal screws. Stud spacing not to exceed 24 in. (610 mm) OC.

C. Batts and Blankets* — (Optional) Any glass fiber insulation bearing the UL Classification Marking as to fire resistance or surface burning characteristics, of a width and thickness to completely fill stud cavity. Insulation batts friction fit to completely fill all stud cavities.

See Batts and Blankets (BZJZ) category in the Fire Resistance Directory for names of manufacturers.

D. Gypsum Board* — One or two layers of 5/8 in. (16 mm) thick gypsum board for 1 and 2 hr rated assemblies, respectively. Wall to be constructed as specified in the individual U400, V400 or W400 Series Design in the UL Fire Resistance Directory, except that a max 3/4 in. (13 mm) gap for 1 and 2 hr rated assemblies shall be maintained between the bottom of gypsum board and top of concrete floor. The hourly fire rating of the joint system is equal to the hourly fire rating of the wall.

3. Bottom Track Seal — CFS-BTS is secured to steel floor runner with adhesive backing and resting tight to the top of the concrete floor assembly prior to installation of gypsum board. Product to be compressed 1/2 in. at seam location by compressing each side evenly.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-BTS 5/8 in. Bottom Track Seal (for use in 1 Hr Application) CFS-BTS 1-1/4 in. Bottom Track Seal (for use in 2 Hr Application)

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
April 02, 2024