




Classified by
Underwriters Laboratories, Inc.
to UL 1479

System No. F-A-2408


ANSI/UL1479 (ASTM E814)
F Rating — 2 Hr
T Rating — 2 Hr

FA 2408

TOP VIEW

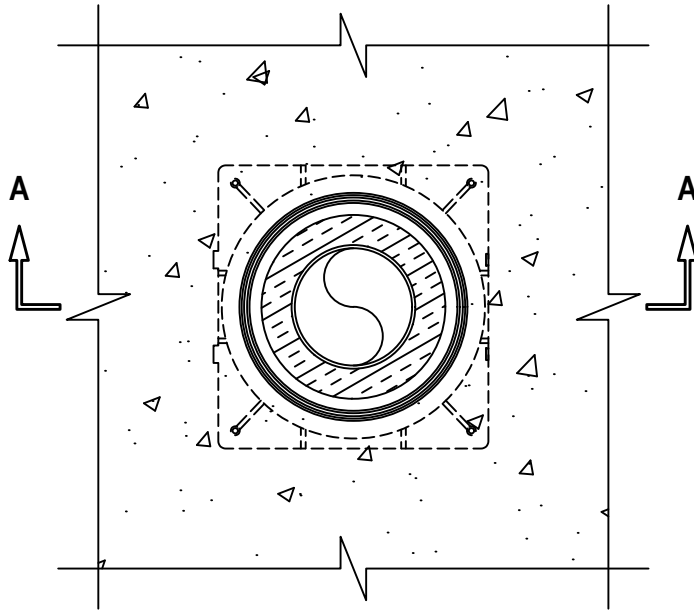

SECTION A-A

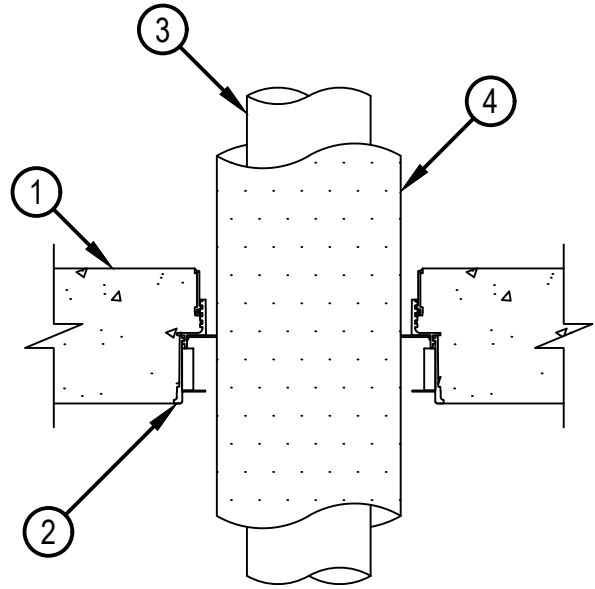

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
March 12, 2024

System No. F-A-2408

FA 2408

1. Floor Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete floor
2. Firestop Device* — Cast in place firestop device with optional accessories including sleeve extension permanently embedded during concrete placement or grouted in concrete assembly in accordance with accompanying installation instructions. The device may extend a max 2 in. (51 mm) above the top surface of the concrete. Device size is dependent on diam of penetrant and pipe covering as specified in Table and in Item 4 below.

Total diameter of penetrant plus insulation *	Firestop Devices
1-1/4 to 2 (32 to 51)	CFS-CID U 2", CFS-CID U 2" CA
2 to 3 (51 to 76)	CFS-CID U 3"
3 to 4 (76 to 102)	CFS-CID U 4"
5 to 6 (127 to 152)	CFS-CID U 6"

* Nom pipe diam in. (mm) with 2 times insulation thickness in (mm) (Item 4 below) will determine which device size to use.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-CID, U 2", CFS-CID U 2" CA, CFS-CID U 3", CFS-CID U 4", CFS-CID U 6"

3. Through Penetrants — One nonmetallic pipe to be centered within the firestop system. Pipe to be rigidly supported on both sides of floor assembly. The following types and sizes of nonmetallic pipes may be used:
 - A. Polyvinyl Chloride (PVC) Pipe — Nom 2 in. (51 mm) diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
 - B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 2 in. (51 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.
 - C. Polypropylene Random (PP-R) Pipe — Nom 2 in. (63 mm OD) diam (or smaller) SDR 7.4 Aquatherm Green pipe for use in closed (process or supply) piping systems.
 - D. Cross Linked Polyethylene (PEX) Tubing — Nom 2 in. (102 mm) diam (or smaller) SDR 9 Uponor AquaPEX or Wirsbo hePEX PEX tubing for use in closed (process or supply) piping systems.
4. Pipe and Equipment Covering Materials* — Nom 1 in. (25 mm), 1-1/2 in. (38 mm) or 2 in. (51mm) thick hollow cylindrical heavy density (min 3.5 pcf) glass fiber units jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product.

See Pipe and Equipment Covering — Materials (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
March 12, 2024