



All loading and design criteria supplied by customer is assumed accurate. Only the stated Design Assumptions were considered, and must be verified by the responsible Engineer of Record (EOR). The basis of Hilti component and connection design is the published data in the current Hilti Technical Guide, including material and cross-section properties, allowable load values, factors of safety, methods of calculation, and limiting factors. The EOR must verify suitability for any specific application, and the capacity of the supportive structure to receive the shown configuration and associated reaction loads. Modification to components and/or design may alter performance and must be evaluated by the EOR.

TYPICAL DETAIL TYPE:

CABLE TRAY SUPPORT

TYPICAL DETAIL DESCRIPTION:

F-SHAPE - 4 ARM

DESIGNED BY: KL
REVIEWED BY: AJV

DRAWN BY: BAP
ISSUE DATE: 17 NOV 14


REVISIONS:

NO.	DESCRIPTION:	DATE:
A	ORIGINAL ISSUE	17 NOV 14
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-


TYPICAL DETAIL NOMENCLATURE:

CT-F02-C

DRAWING NUMBER: 01
SHEET: 1/1

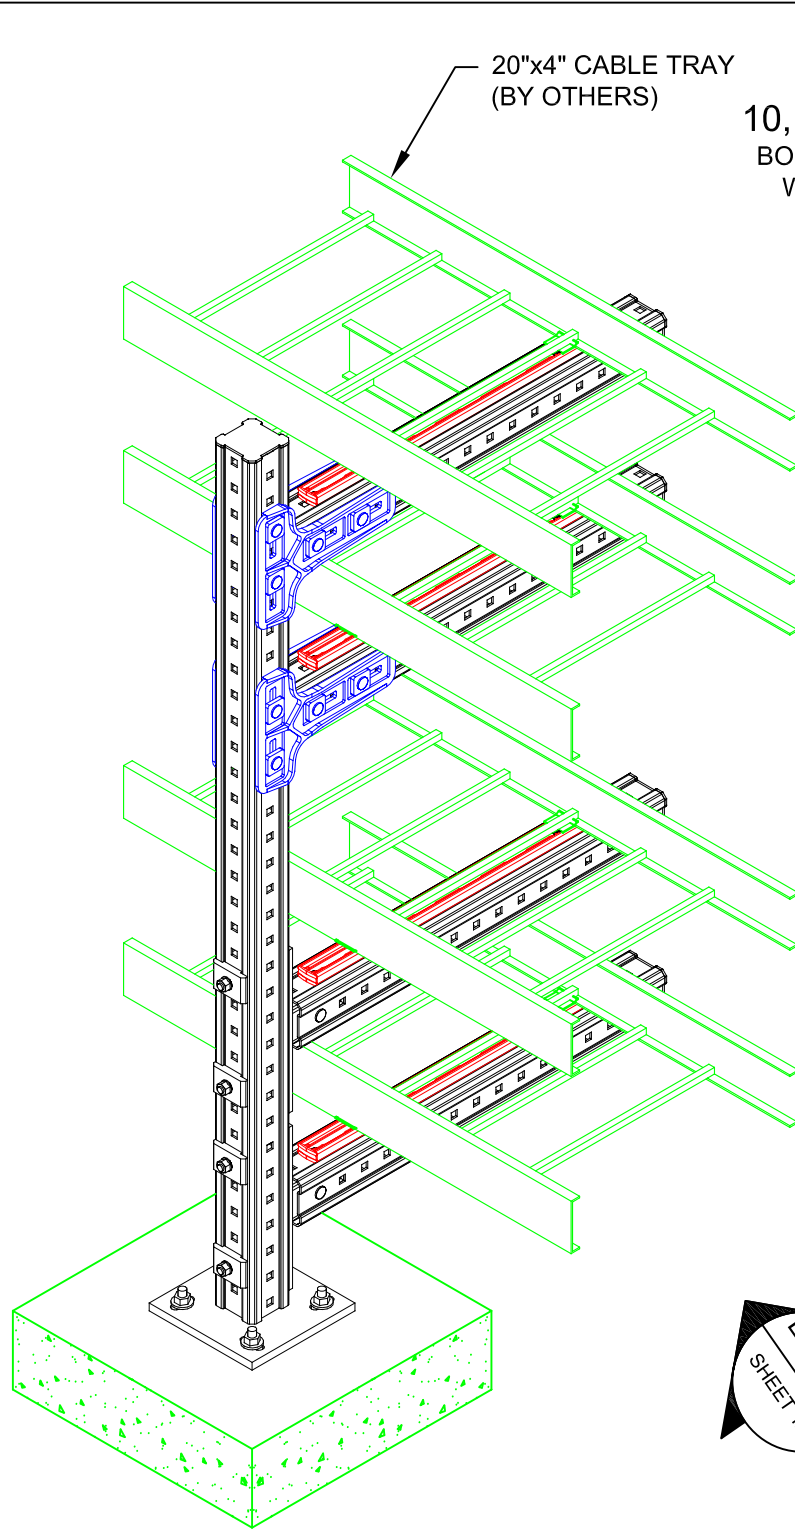

01 ISOMETRIC
N.T.S.

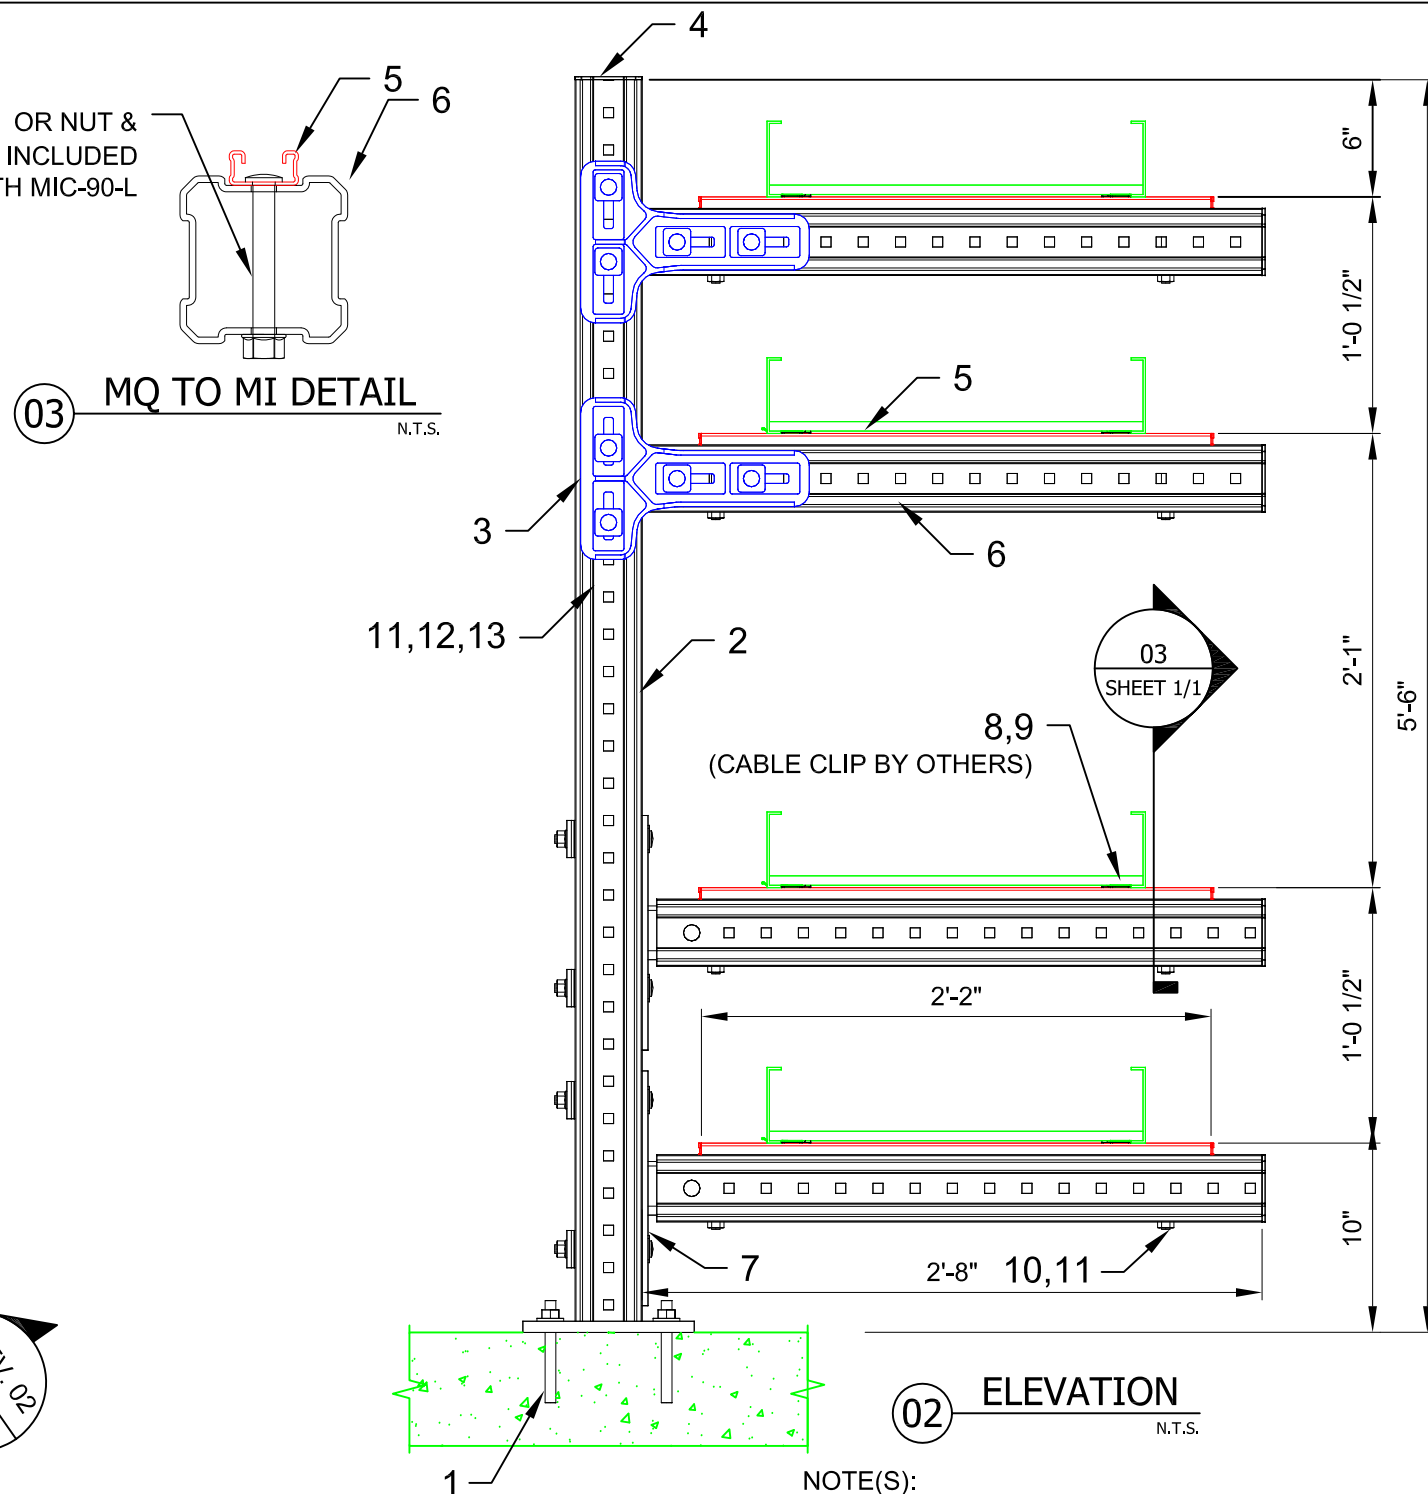

02 ELEVATION
N.T.S.

- NOTE(S):**
- PRELIMINARY NOT FOR CONSTRUCTION.
 - DESIGN ASSUMPTIONS:
 - DESIGN LOADS (STATIC, U.N.O.):
 20" TRAY LOAD = 26 lb/ft PER TRAY
 DESIGN LOADS PER ASCE 7-10 BASED ON SITE AT FRESNO, CA
 BASIC WIND LOAD = 115mph
 WIND EXPOSURE = C
 SEISMIC DESIGN VALUES
 IMPORTANCE FACTOR = 1.50
 S_{ds} = 0.607 (SHORT PERIOD)
 S_{d1} = 0.350 (LONG PERIOD)
 - LATERAL LOADS NOT CONSIDERED
 - BUILDING CODE: IBC 2006 / 2009 / 2012
 - CORROSION RESISTANCE REQ'D.: HDG / SS / EG
 - MAX. SUPPORT SPACING = 6'-0"
 - FOR LOCATION WITH FEWER TRAYS, DELETE ARMS AND CONNECTORS AS REQ'D.
 - REFER TO COMPONENT MANUFACTURER'S IFUs FOR REQUIRED INSTALLATION INFO.
 - E.O.R. MUST BE NOTIFIED OF ANY DEVIATIONS FROM EXISTING/ NEW SUBSTRATE CONDITIONS SHOWN HEREIN TO VALIDATE ACCEPTANCE OF THIS HILTI DESIGN PRIOR TO INSTALLATION.

No.	Unit Qty	Unit	Description	Box Qty	# Boxes Needed	Item No.
1	4	EA	USE KB3 OR KB-TZ AS APPROPRIATE	VARIES	VARIES	VARIES
2	1	EA	CONNECTOR MIC-C90-D-2000 WELDED BRACKET	1	1	267793
3	2	EA	CONNECTOR MIC-90-LH	-	-	SPECIAL
4	5	EA	GIRDER END CAP MIA-EC90	25	1	432077
5	AS REQ'D	EA	STRUT MS-1316-12/HDG 9'-10" (3M)	1	AS REQ'D	407569
6	AS REQ'D	EA	GIRDER MI-90 3M	1	AS REQ'D	304798
7	2	EA	CONNECTOR MIC-90-L	2	1	304805
8	8	EA	WING NUT MQM-F3/8"-F	25	1	304136
9	8	EA	3/8"x1/2"LONG HDG HEX HEAD BOLT	-	-	SPECIAL
10	5	EA	ONEHAND SCREW MIA-OH90	10	1	304889
11	9	EA	MI HEX NUT M12-F-SL-WS 3/4"	100	1	382897
12	4	EA	EASYHAND SCREW MIA-EH90	10	1	304887
13	4	EA	TOOTHED PLATE MIA-TP	20	1	305707