



Classified by
Underwriters Laboratories, Inc.
to UL 2079 and CAN/ULC-S115


System No. FF-D-0052

F Rating - 2 Hr

Normal Joint Width - 1/2 in.

Class II Movement Capabilities - 12.5% Compression or Extension

FFD 0052

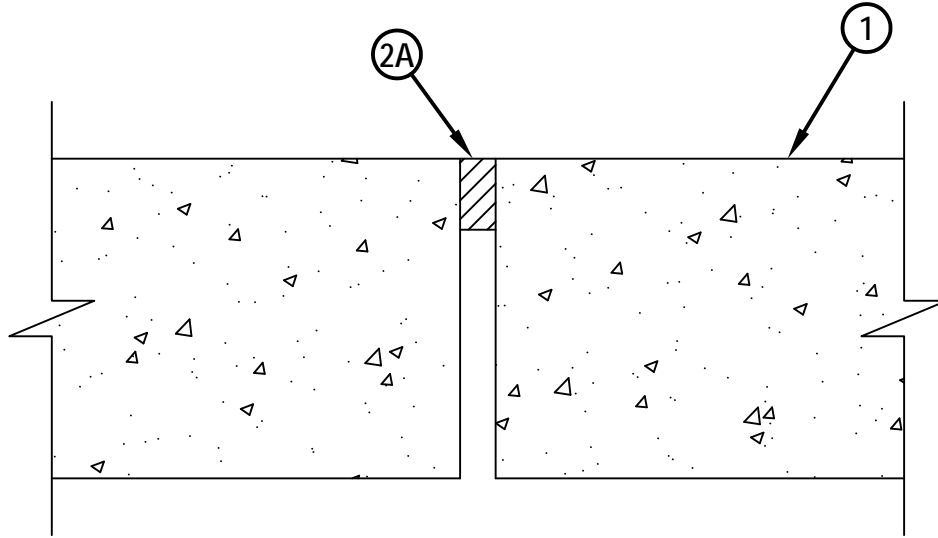

1. Floor Assembly - Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete.
2. Joint System - Max width of joint (at time of installation of joint system) is 1/2 in. (13 mm). The joint system is designed to accommodate a max 12.5 percent compression or extension from it's installed width. The joint system shall consist of the following:
 - A. Fill, Void or Cavity Material* - Sealant - Min 1 in. (25 mm) thickness of fill material applied within the joint, flush with top surface of floor.

HILTI CONSTRUCTION CHEMICALS, DIV OF
HILTI INC - CP 606 Flexible Firestop Sealant

*Bearing the UL Classification Mark



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
September 13, 2004