



Classified by
Underwriters Laboratories, Inc.
to UL 2079 and CAN/ULC-S115

System No. HW-D-1078

Assembly Rating — 2 Hr


Nominal Joint Width — 3 In.

Class II Movement Capabilities — 17% Compression Or Extension

L Rating at Ambient — Less than 1 CFM/Lin Ft

L Rating at 400 F — Less than 1 CFM/Lin Ft

HWD 1078

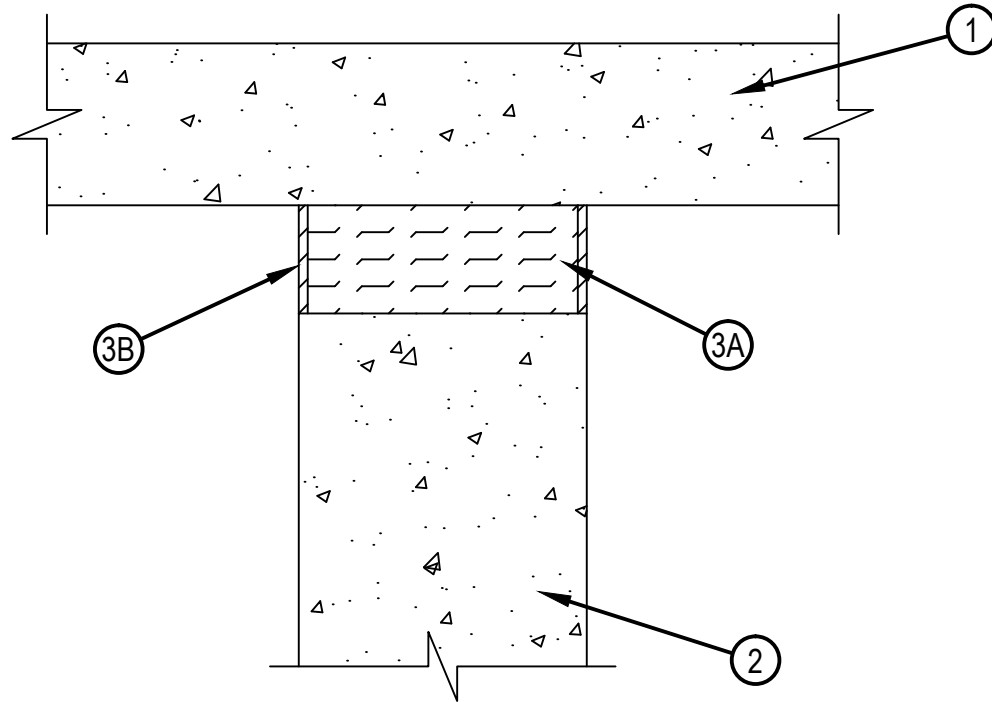

1. Floor Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg /m³) structural concrete.
2. Wall Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg /m³) structural concrete.
Wall may also be constructed of any UL Classified Concrete Blocks*.
See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.
3. Joint System — Max separation between bottom of floor and top of wall (at time of installation of joint system) is 3 in. (76 mm). The joint system is designed to accommodate a max 17 percent in compression or extension from its installed width. The joint system shall consist of the following:
 - A. Forming Material — Min 4 pcf (64 kg/m³) mineral wool batt insulation installed in joint opening as a permanent form. Pieces of batt cut to min width of 4 in. (102 mm) and installed edge-first into joint opening, parallel with joint direction, such that batt sections are compressed min 40 percent in thickness and that the compressed batt sections are recessed from both surfaces of the wall to accommodate the required thickness of fill material. Adjoining lengths of batt to be tightly-butted with butted seams spaced min 24 in. (610 mm) apart along the length of the joint.
FIBREX INSULATIONS INC — FBX Safing Insulation
 - A1. Forming Material (as an alternate to item 3A) — Min 6 pcf (96 kg/m³) ceramic blanket insulation installed in joint as a permanent form. Pieces of batt cut to min width of 4 in. (102 mm) and installed edge-first into joint opening, parallel with joint direction, such that batt sections are compressed min 50 percent in thickness and that the compressed batt sections are recessed from both surfaces of the wall to accommodate the required thickness of fill material. Adjoining lengths of batt to be tightly-butted with butted seams spaced min 24 in. (610 mm) apart along the length of the joint.
 - B. Fill, Void or Cavity Material* — Sealant — Min 1/4 in. (6 mm) thickness of fill material applied within the joint, flush with both surfaces of wall.
HILTI CONSTRUCTION CHEMICALS, DIV OF
HILTI INC — CP606 Flexible Firestop Sealant

*Bearing the UL Classification Mark



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
July 13, 2009