




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. C-AJ-0090

CAJ 0090

ANSI/ UL1479 (ASTM E814)	CAN/ULC S115
F Rating - 2hr	F Rating - 2 Hr
T Rating - 1-1/2 Hr	FT Rating - 1-1/2 Hr
	FH Rating - 2 Hr
	FTH Rating - 1-1/2 Hr

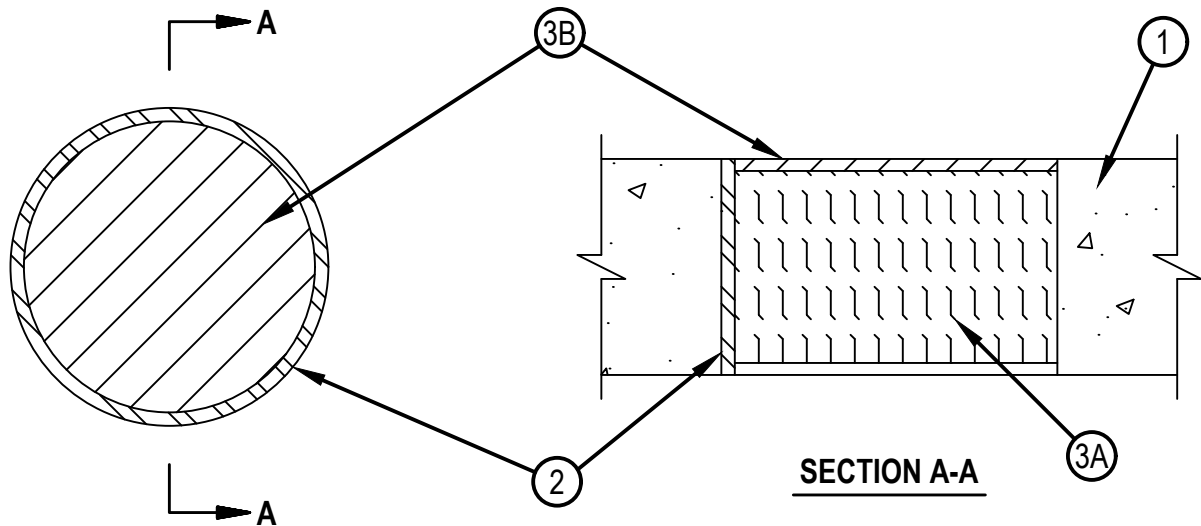

1. Floor or Wall Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Max diameter of opening is 6 in. (152 mm).
See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.
2. Steel Sleeve — (Optional)-Nom 6 in. (152 mm) diameter (or smaller) Schedule 40 (or heavier) steel pipe cast or grouted into the floor or wall assembly, flush with floor or wall surfaces.
3. Firestop System — The firestop system shall consist of the following:
 - A. Packing Material — Min 4 in. (102 mm) thickness of 4 pcf (64 kg/m³) mineral wool batt insulation tightly packed into the opening as a permanent form. Packing material to be recessed from top surface of floor and both surfaces of wall to accommodate the required thickness of fill material.
 - B. Fill, Void or Cavity Materials* — Sealant — Min 1/4 in. (6 mm) thickness of fill material applied within the annulus, flush with top surface of floor.
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant or FS-ONE MAX Intumescent Sealant

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
November 15, 2021