

COMMERCIAL BUILDING			
Floor Substrate: Concrete over metal deck			
SHEET	JOINT	SYSTEM	DESCRIPTION
11	FLOORS	F.A.2016	METAL PIPE THROUGH CONCRETE FLOOR (2HR)
		F.A.2018	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		F.A.2023	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		F.A.2026	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		F.A.2065	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		F.A.2073	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		F.A.2015	METAL PIPE WITH ABRVIC INSULATION THROUGH CONCRETE FLOOR (2HR)
		F.A.2017	METAL PIPE WITH GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2HR)
		F.A.2048	METAL PIPE WITH ABRVIC OR GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2HR)
		CAJ.1206	METAL PIPE THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.1201	METAL PIPE THROUGH CONCRETE FLOOR (2HR)
12	FLOORS OR WALLS	CAJ.1913	MULTIPLE METAL PIPES THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.2109	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.2107	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.3095	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.3303	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.4090	METAL PIPE WITH ABRVIC INSULATION THROUGH CONCRETE FLOOR (2HR)
		CAJ.4091	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH CONCRETE FLOOR (2HR)
		CAJ.4042	ELECTRICAL BUSWAY THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.1901	METAL DUCT WITHOUT DAMPERS THROUGH CONCRETE OR MASONRY (2HR)
		CAJ.1904	ROUND SHEET METAL DUCT THROUGH CONCRETE FLOOR (2HR)
		CAJ.1711	METAL DUCT WITHOUT DAMPERS THROUGH CONCRETE FLOOR (2HR)
		CAJ.1745	SHEET METAL DUCT WITH GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2HR)
		CAJ.4069	MULTIPLE PENETRATIONS THROUGH CONCRETE FLOOR (2HR)
		CAJ.4143	MULTIPLE PENETRATIONS THROUGH CONCRETE FLOOR (2HR)
		WCL.1564	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WCL.1389	MULTIPLE METAL PIPES THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WCL.2018	PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WCL.2128	PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WCL.3304	CABLE BUNDLE THROUGH GYPSUM WALL ASSEMBLY (2HR)
WCL.3414	CABLE THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.4089	PLASTIC PIPE WITH ABRVIC INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.5029	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.1942	METAL DUCT WITHOUT DAMPERS THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.1935	METAL DUCT THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.1936	METAL DUCT WITH GLASS FIBER INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.1939	MULTIPLE PENETRATIONS THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.2475	CABLE THROUGH CONCRETE OR BLOCK WALL ASSEMBLY (2HR)		
WCL.2476	MEMBRANE PENETRATION THROUGH GYPSUM WALL ASSEMBLY (2HR)		
WCL.2478	MEMBRANE PENETRATION THROUGH GYPSUM WALL ASSEMBLY (2HR)		
14	CONCRETE OR MASONRY WALLS		
15	MEMBRANE PENETRATION		
SHEET	JOINT	SYSTEM	DESCRIPTION
16	GYPSUM WALL	HWD-0242	TOP OF WALL JOINT (2HR)
		HWD-0246	TOP OF WALL JOINT (2HR)
		HWD-0248	TOP OF WALL JOINT (2HR)
		HWD-0244	TOP OF WALL JOINT (2HR)
		HWD-0256	TOP OF WALL JOINT (2HR)
17	GYPSUM SHAFT WALL	HWD-0234	TOP OF WALL JOINT (2HR)
		HWD-0269	TOP OF WALL JOINT (2HR)
		HWD-0270	TOP OF WALL JOINT (2HR)
18	CONCRETE OR MASONRY WALLS	HWD-0107	TOP OF WALL JOINT (2HR)

**UL FIRE RESISTANCE DIRECTORY NOMENCLATURE**

Through Penetrations			
First letter represents what is being penetrated	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: CAJ1150
F = FLOOR W = WALLS C = FLOORS OR WALLS (COMBINED)	A = CONCRETE FLOORS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 5 IN  B = CONCRETE FLOORS WITH A MINIMUM THICKNESS GREATER THAN 5 IN  C = FRAMED FLOORS  E = FOR-CEILING ASSEMBLIES CONSISTING OF CONCRETE WITH MEMBRANE PROTECTION  J = CONCRETE OR MASONRY WALLS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 8 IN  L = FRAMED WALLS	0000 - 0999 BLANK OPENINGS  1000 - 1999 METAL PIPE, CONDUIT OR TUBING 2000 - 2999 NON METALLIC PIPE CONDUIT OR TUBING  3000 - 3999 CABLES 4000 - 4999 CABLE TRAYS  5000 - 5999 INSULATED PIPES 6000 - 6999 MISCELLANEOUS ELECTRICAL (BUSWAY)  7000 - 7999 MISCELLANEOUS MECHANICAL 8000 - 8999 MIXED PENETRATING ITEMS 9000 - 9999 RESERVED FOR FUTURE USE	C = FLOOR OR WALLPENETRATION  A = CONCRETE FLOORS 5" OR LESS  J = CONCRETE OR MASONRY WALLS 8" OR LESS  1150 = METAL PIPE, CONDUIT OR TUBING

Joint Systems			
First letters identify the type of joint:	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: HWD0757
CJ = CONTINUITY HEAD OF WALL FF = FLOOR TO FLOOR WW = WALL TO WALL FW = FLOOR TO WALL HW = HEAD TO WALL BW = BOTTOM OF WALL	S = NO MOVEMENT (STATIC)  D = ALLOWS MOVEMENT (DYNAMIC)	0000 - 0999 LESS THAN OR EQUAL TO 2"  1000 - 1999 GREATER THAN 2" AND LESS THAN OR EQUAL TO 6"  2000 - 2999 GREATER THAN 6" AND LESS THAN OR EQUAL TO 12"  3000 - 3999 GREATER THAN 12" AND LESS THAN OR EQUAL TO 24"  4000 - 4999 GREATER THAN 24"	HW = HEAD TO WALL  D = ALLOWS MOVEMENT (DYNAMIC)  0757 = LESS THAN OR EQUAL TO 2"

**Notes:**

- Refer to the following specifications for firestopping.
  - 07 84 00 Firestopping
  - 07 84 13 Penetration Firestopping
  - 07 84 43 Joints Firestopping
  - 22 00 00 Plumbing
  - 23 00 00 HVAC
  - 26 00 00 Electrical
  - 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
  - \* Fire Rating (F-Rating)
  - \* Temperature Rating (T-Rating)
  - \* Leakage Rating (L-Rating)
  - \* Water Rating (W-Rating)
  - \* Annular Space
  - \* Percent Fill
  - \* Movement
  - \* Type and thickness of fire-rated construction.

- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
  - \* 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
  - \* NFPA 101 Life Safety Code
  - \* NFPA 70 – National Electric Code
  - \* All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
  - \* Warning! - Do Not Disturb
  - \* Through Penetration Firestop System
  - \* UL System # \* Product(s) used
  - \* Hourly Rating (F-Rating)
  - \* Installation Date
  - \* Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>  
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.  
 2. Details shown are up to date as of February 2015.  
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: \_\_\_\_\_

DRAWN: \_\_\_\_\_

CHECKED: \_\_\_\_\_

ISSUE DATE: 01-25-2018

REVISIONS: \_\_\_\_\_

SHEET NAME: \_\_\_\_\_  
Index of Drawings


SHEET NUMBER: \_\_\_\_\_







System No. W-J-3215	
ANSI/UL 1479 (ASTM E814)	CANULC S115
F Rating — 2 Hr	F Rating — 2 Hr
T Rating — 1/2 and 2 Hr (See Item 2)	FT Ratings — 1/2 and 2 Hr (See Item 2)
L Rating at Ambient — Less than 1	PH Rating — 2 Hr
CFM/Opening	
T Rating at 400°F — Less than 1	
CFM/Opening	
	L Rating at Ambient — Less than 1
	CFM/Opening
	L Rating at 400°F — Less than 1
	CFM/Opening

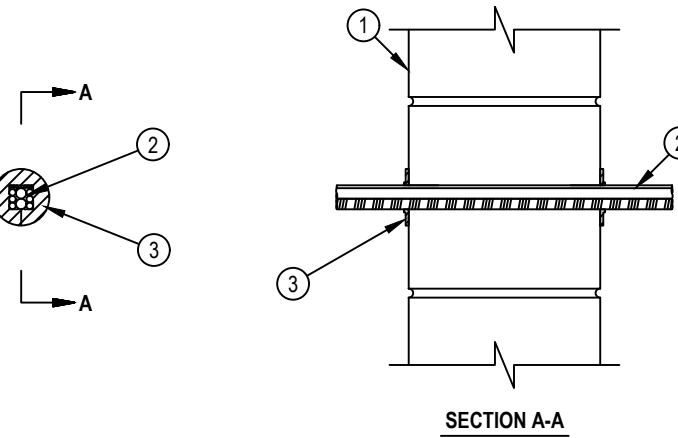

System No. W-J-3215	
1. Wall Assembly — Min 6 in. (152 mm) thick lightweight or normal weight (150-150 pcf or 1600-2400 kg/m <sup>3</sup> ) concrete. Wall may also be constructed of any UL Classified Concrete Block*. Opening may be round, rectangular or irregular with a max diam or dimension of 1 in. (25 mm).	
2. See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.	
3. Cables — Single or split bundles of cables to be installed within the opening. Aggregate cross-sectional area of cables in opening to have a residual of min 7% to max 10%. The annular space between the cable bundle and the periphery of the opening to be min 0 in. (joint contact). Cables to be rigidly supported on both sides of the wall assembly. Any combination of the following types and sizes of cables may be used:	
A. Max 3C No. 14 AWG (30 AWG copper conductor cable (Belden)) with PVC insulation and jacket.	
B. Max 10C No. 12 AWG (30 AWG copper conductor control cable with PVC or PLF insulation and jacket).	
C. Max 10C No. 14 AWG (30 AWG copper conductor telecommunication cable with PVC or plenum rated insulation and jacketing).	
D. Max 4C No. 22 AWG (or smaller) Cat 5E copper cables with PVC or plenum rated insulation and jacketing.	
E. Type HCLJ (Class B) cables with full rated annular of PVC insulation and jacketing having a max outside diameter of 1/4 in. (3 mm).	
F. Max 24 fiber optic cable with polyimide (PVC) or polyethylene (PE) jacket and insulation.	
G. Through penetrating module* — Max two copper conductor No. 18 AWG (or smaller) Power or Non-Power Limited Fire Alarm Cable with or without a jacket under a single entry.	
H. Maximum 3C No. 14 AWG metal-clad cable.	
Note: 1. FT and FTN Ratings of the firestop system are 2 Hr except that for cable type B and C, the ratings are 1 Hr. For blank openings with no penetrations, the FT, FTN and FTN Ratings are 2 Hr.	
2. Pl. "Void or Cavity Insulation" — Min 1/4 in. (6 mm) thick rigid, non-combustible. Paper-backed or disc to be removed and disc firmly pressed around the cable bundle lapsing from 5 mm into cables to completely cover opening and firmly pressed to lap onto the wall around perimeter of opening. Disc must be firmly pressed and sealed tight. Disc to be installed at both surfaces of wall.	
HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-D T Firestop Cable Disc	
* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.	

Notes:

1. Refer to the following specifications for firestopping.
  - a. 07 84 00 Firestopping
  - b. 07 84 13 Penetration Firestopping
  - c. 07 84 43 Joints Firestopping
  - d. 22 00 00 Plumbing
  - e. 23 00 00 HVAC
  - f. 26 00 00 Electrical
  - g. 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

2. Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
  - \* Fire Rating (F-Rating)
  - \* Temperature Rating (T-Rating)
  - \* Leakage Rating (L-Rating)
  - \* Water Rating (W-Rating)
  - \* Annular Space
  - \* Percent Fill
  - \* Movement
  - \* Type and thickness of fire-rated construction.

3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

4. References:
  - \* 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
  - \* NFPA 101 Life Safety Code
  - \* NFPA 70 – National Electric Code
  - \* All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

6. All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
  - \* Warning! - Do Not Disturb Through Penetration Firestop System
  - \* UL System # \* Product(s) used
  - \* Hourly Rating (F-Rating)
  - \* Installation Date
  - \* Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017.  
 System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>  
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.  
 2. Details shown are up to date as of February 2015.  
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: \_\_\_\_\_

DRAWN: \_\_\_\_\_

CHECKED: \_\_\_\_\_

ISSUE DATE: 01-25-2018

REVISIONS: \_\_\_\_\_

SHEET NAME:  
 Commercial - Concrete Over Metal Deck - Concrete or Masonry Walls

SHEET NUMBER: \_\_\_\_\_

1 or 2 Hr Gypsum Wall Assembly (2 Hr Show)

Power Cable

18" Thick CP817 or CP8-PA Firestop Putty Pad

Wood Stud or Steel Stud (Not Show)

UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 01, 2018.

Hilti Firestop Systems

Page 1 of 5

1 or 2-Hr Gypsum Wall Assembly (2-Hr Show)

Steel Stud or Wood Stud (Not Show)

Power Cable

Firestop Box Insert

UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 01, 2018.

Hilti Firestop Systems

Page 2 of 5

1 or 2 Hr Gypsum Wall Assembly (2-Hr Show)

Steel Stud or Wood Stud (Not Show)

Power Cable

Firestop Box Insert

UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 01, 2018.

Hilti Firestop Systems

Page 3 of 5

1 or 2 Hr Gypsum Wall Assembly (2-Hr Show)

Steel Stud or Wood Stud (Not Show)

Power Cable

Firestop Box Insert

UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 01, 2018.

Hilti Firestop Systems

Page 4 of 5

1 or 2 Hr Gypsum Wall Assembly (2-Hr Show)

Steel Stud or Wood Stud (Not Show)

Power Cable

Firestop Box Insert

UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 01, 2018.

Hilti Firestop Systems

Page 5 of 5

- Notes:
- Refer to the following specifications for firestopping.
    - 07 84 00 Firestopping
    - 07 84 13 Penetration Firestopping
    - 07 84 43 Joints Firestopping
    - d.22 00 00 Plumbing
    - e.23 00 00 HVAC
    - f.26 00 00 Electrical
    - g.27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
  - \* Fire Rating (F-Rating)
  - \* Temperature Rating (T-Rating)
  - \* Leakage Rating (L-Rating)
  - \* Water Rating (W-Rating)
  - \* Annular Space
  - \* Percent Fill
  - \* Movement
  - \* Type and thickness of fire-rated construction.

- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
  - \* 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
  - \* NFPA 101 Life Safety Code
  - \* NFPA 70 – National Electric Code
  - \* All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
  - \* Warning! - Do Not Disturb Through Penetration Firestop System
  - \* UL System # \* Product(s) used
  - \* Hourly Rating (F-Rating)
  - \* Installation Date
  - \* Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, Category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>  
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.  
 2. Details shown are up to date as of February 2015.  
 3. For additional information on the details, refer to the most current "Underwriter's Laboratories Fire Resistance Directory (volume 2)."

JOB NUMBER: \_\_\_\_\_

DRAWN: \_\_\_\_\_

CHECKED: \_\_\_\_\_

ISSUE DATE: 01-25-2018

REVISIONS: \_\_\_\_\_

SHEET NAME: Commercial - Concrete Over Metal Deck - Membrane Penetration

SHEET NUMBER: \_\_\_\_\_

**System No. HW-D-0042**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H  
Class I Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 1 of 4

**System No. HW-D-0042**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 2 of 4

**System No. HW-D-0042**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 3 of 4

**System No. HW-D-0042**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 4 of 4

**System No. HW-D-0045**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 1 of 2

**System No. HW-D-0045**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 2 of 2

**System No. HW-D-0045**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 3 of 3

**System No. HW-D-0049**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Items 2 and 3B)  
Nominal Joint Width — 1/8 in.  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 1 of 3

**System No. HW-D-0049**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Items 2 and 3B)  
Nominal Joint Width — 1/8 in.  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 2 of 3

**System No. HW-D-0049**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Items 2 and 3B)  
Nominal Joint Width — 1/8 in.  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 3 of 3

**System No. HW-D-0085**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 1 of 3

**System No. HW-D-0085**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 2 of 3

**System No. HW-D-0085**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 3 of 3

**System No. HW-D-0085**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 4 of 4

**System No. HW-D-0184**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 1 of 3

**System No. HW-D-0184**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 2 of 3

**System No. HW-D-0184**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 3 of 3

**System No. HW-D-0259**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Items 1 and 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 1 of 3

**System No. HW-D-0259**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Items 1 and 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 2 of 3

**System No. HW-D-0259**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Items 1 and 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 3 of 3

**System No. HW-D-0259**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Items 1 and 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 4 of 4

**System No. HW-D-0324**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 1 of 2

**System No. HW-D-0324**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 and 2 Hr (See Item 2)  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. December 16, 2015. Page 2 of 2

**System No. HW-D-0342**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 Hr  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. March 23, 2012. Page 1 of 2

**System No. HW-D-0342**  
ANSI/UL 2079 CANULC 5115  
Assembly Rating — 1 Hr  
Nominal Joint Width — 1/8 in.  
Class II Movement Capabilities — 50% Compression or Extension  
L Rating Ambient — Less Than 1 CFM/Flt H  
L Rating A407F — Less Than 1 CFM/Flt H

Reproduced by HLL, Inc. Courtesy of Underwriters Laboratories, Inc. March 23, 2012. Page 2 of 2

Notes:


- Refer to section 07840 of the specifications, refer to the Quality Control portion of the specification.
- Details shown are typical details. Field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
  - Minimum and maximum Width of Joints
  - Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
- References:
  - 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
  - Intertek Directory of Building Products
  - All governing local and regional building codes

<Notes to designer (delete this note after reading and replace with title block information)>  
1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.  
2. Details shown are up to date as of February 2015.  
3. For additional information on the details, refer to the most current "Underwriters Laboratories Fire Resistance Directory (volume 2)".

JOB NUMBER:  
DRAWN:  
CHECKED:  
ISSUE DATE: 01-25-2018  
REVISIONS:  
SHEET NAME:  
Commercial - Concrete Over Metal Deck Gypsum Walls  
SHEET NUMBER:  
1.6





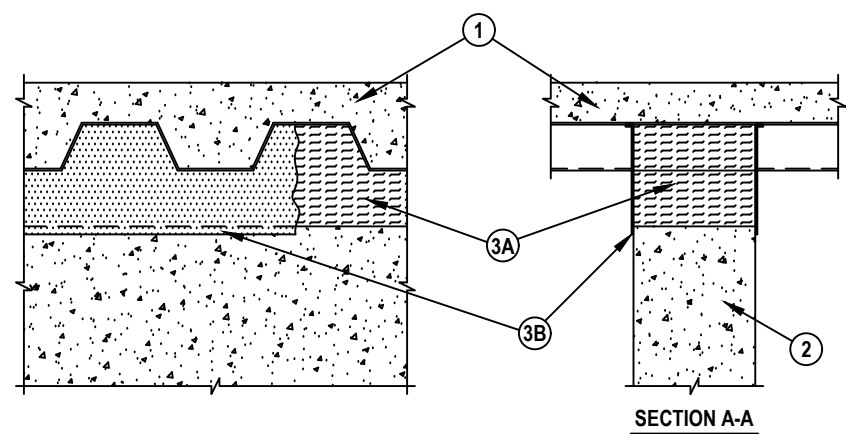

1. Floor Assembly — The fire-rated steel floor/anticoncrete floor assembly shall be constructed of the materials and in the manner described in the individual Floor/Ceiling Design in the Fire Resistance Directory and shall include the following construction features:  
 A. Steel Floor and Form Units — Max 3/8" (15.9 mm) deep galv steel floor units.  
 B. Concrete — Min 2 1/2" (64 mm) thick structural concrete, as measured from the top flange of the floor units.  
 C. Spray Applied Fire Resistant Material — (Optional) — (Not Shown) — Prior to the installation of the forming material and fill, void or cavity material (Items 3A, 3B) the steel floor units may be sprayed with a min 5/16" (8 mm) or max 1/32" (1.6 mm) thickness of the resistive material.  
 FIRE GRACE (GG) — (Optional) — Type MFC-101  
 1A. Roof Assembly (Not Shown) — As an alternate to the floor assembly, a fire-rated steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual 1900 Series Roof/Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:  
 A. Steel Roof Deck — Max 3/8" (15.9 mm) deep galv steel roof deck.  
 B. Roof Insulation — Min 2 1/4" (57 mm) thick insulating concrete, as measured from the top flange of the floor units.  
 1B. Roof Assembly — As an alternate to Items 1 and 1A, a fire-rated precast steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual P700 Series Roof/Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:  
 A. Steel Roof Deck — Max 3/8" (15.9 mm) deep galv steel roof deck.  
 B. Spray Applied Fire Resistant Material — (Not Shown) — Prior to the installation of the steel ceiling runners, Forming Material and Fill, Void or Cavity Material (Items 2A, 2B, 3B), the roof assembly shall be sprayed with the type and thickness of fire resistive material indicated in the individual P700 Series Design.  
 2. Wall Assembly — Min 8 in. (203 mm) thick steel reinforced lightweight or normal weight (100-150 pcf) (900-2400 kg/m<sup>3</sup>) structural concrete. Wall may also be constructed of any UL Classified Concrete Block.  
 See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

3. Joint System — Max separation between bottom of floor units and top of concrete wall at time of installation is 5-10 in. (89 mm). The joint system is designed to accommodate a max 14 percent compression or extension from its installed width. The joint system shall consist of the following:  
 A. Forming Material — Min 4 in. (102 mm) thick pieces of nominal 4 pcf (64 kg/m<sup>3</sup>) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to complete fill the hole). Additional pieces of steel insulation, min 6 in. (203 mm) wide, shall be compressed 50 percent in thickness and installed edge first into joint opening between bottom of fluted floor or roof units and top of concrete wall.  
 THERMAT BEER INC. — Type S4F  
 A1. Forming Material — (Plug) — (Optional Not Shown) Performed mineral wool plugs, formed in the shape of the fluted floor units, Section B to completely fill the hole above the ceiling runner. The plugs shall be flush with both wall surface. Additional forming material, described in Item 3A, to be used in conjunction with the plugs to fill the gap between the top of the wall and the bottom of the steel floor units.  
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — CP1777 Speed Plug  
 A2. Forming Material — As an alternate to Item 3A, min 1/2" (12.7 mm) rigid polyisocyanurate insulation installed in joint as a permanent form. Nominal 4 in. (102 mm) thick pieces of nominal 4 pcf (64 kg/m<sup>3</sup>) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to complete fill the hole). Additional pieces of steel insulation, min 6 in. (203 mm) wide, shall be compressed 50 percent in thickness and installed edge first into joint opening between bottom of fluted floor or roof units and top of concrete wall.  
 B. Void or Cavity Material — (Optional) — A 1/8 in. (3.2 mm) thick thickness of FR material (topped of inside on each side of wall) to completely cover mineral wool forming material and to overlap a min 1/2 in. (13 mm) onto steel floor units and concrete wall. When spray applied the positive expansion is applied to the steel deck, the FR material is to overlap the wall 1/4 in. and the spray applied the resistive material a min of 2 in. (51 mm) on both sides of the wall.  
 HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. — CP822 Firestop Spray or CFS-SP V8 Firestop Joint Spray

Notes:

1. Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
2. Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:  
 \* Minimum and maximum Width of Joints  
 \* Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.  
 3. If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.  
 4. References:  
 \* 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2  
 \* Intertek Directory of Building Products  
 \* All governing local and regional building codes

Current as of November 19, 2017.  
 System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>  
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.  
 2. Details shown are up to date as of February 2015.  
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: \_\_\_\_\_

DRAWN: \_\_\_\_\_

CHECKED: \_\_\_\_\_

ISSUE DATE: 01-25-2018

REVISIONS: \_\_\_\_\_

SHEET NAME:  
 Commercial - Concrete  
 Over Metal Deck -  
 Concrete or Masonry  
 Walls

SHEET NUMBER: \_\_\_\_\_