

HEALTHCARE BUILDING		Floor Substrate: Concrete over metal deck	
SHEET	REF. PENETRATIONS THRU	SYSTEM	DESCRIPTION
2.1	FLOORS	FA-1016	METAL PIPE THROUGH CONCRETE FLOOR (2HR)
		FA-2005	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		FA-2005	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		FA-2005	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		FA-2005	PLASTIC PIPE THROUGH CONCRETE FLOOR (2HR)
		FA-2015	METAL PIPE WITH AEROPIC INSULATION THROUGH CONCRETE FLOOR (2HR)
		FA-2017	METAL PIPE WITH GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2HR)
		FA-2046	METAL PIPE WITH AEROPIC OR GLASS FIBER INSULATION THROUGH CONCRETE FLOOR (2HR)
		CA-1206	METAL PIPE THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1201	METAL PIPE THROUGH CONCRETE OR MASONRY (2HR)
2.2	FLOORS OR WALLS	CA-1015	METAL PIPE THROUGH CONCRETE OR MASONRY (2HR)
		CA-1207	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2HR)
		CA-1207	PLASTIC PIPE THROUGH CONCRETE OR MASONRY (2HR)
		CA-1305	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2HR)
		CA-1305	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2HR)
		CA-1305	CABLE BUNDLE THROUGH CONCRETE OR MASONRY (2HR)
		CA-1385	CABLE TRAY THROUGH CONCRETE OR MASONRY (2HR)
		CA-1385	CABLE TRAY THROUGH CONCRETE OR MASONRY (2HR)
		CA-1386	METAL PIPE WITH AEROPIC INSULATION THROUGH CONCRETE OR MASONRY (2HR)
		CA-1387	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH CONCRETE OR MASONRY (2HR)
2.3	FLOORS OR WALLS	CA-1607	ELECTRICAL BUSWAY THROUGH CONCRETE OR MASONRY (2HR)
		CA-1607	ELECTRICAL BUSWAY THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1001	METAL DOOR (WITHOUT DAMPER) THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1001	METAL DOOR (WITHOUT DAMPER) THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1111	METAL DOOR (WITH DAMPER) THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1111	METAL DOOR (WITH DAMPER) THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1147	METAL DOOR WITH GLASS FIBER INSULATION THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1809	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1809	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		CAJ-1809	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
2.4	GYPSUM WALLS	WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-1004	METAL PIPE THROUGH GYPSUM WALL ASSEMBLY (2HR)
2.5	GYPSUM WALLS	WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
		WL-2011	METAL PIPE WITH GLASS FIBER OR CALCIUM SILICATE INSULATION THROUGH GYPSUM WALL ASSEMBLY (2HR)
2.6	CONCRETE OR MASONRY WALLS	WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
		WC-1000	MULTIPLE CABLE BUNDLES THROUGH CONCRETE OR MASONRY (2HR)
2.7	MEMBRANE PENETRATION	MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
		MEM-1000	MULTIPLE PENETRATIONS THROUGH CONCRETE OR MASONRY (2HR)
2.8	JOINTS	HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
2.9	JOINTS	HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
2.10	JOINTS	HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)
		HW-0001	BOTTOM OF WALL JOINT (2HR)

UL FIRE RESISTANCE DIRECTORY NOMENCLATURE

Through Penetrations

First letter represents what is being penetrated	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: CAJ1150
F = FLOOR W = WALLS C = FLOORS OR WALLS (COMBINED)	A = CONCRETE FLOORS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 5 IN B = CONCRETE FLOORS WITH A MINIMUM THICKNESS GREATER THAN 5 IN C = FRAMED FLOORS E = FOR-CEILING ASSEMBLIES CONSISTING OF CONCRETE WITH MEMBRANE PROTECTION J = CONCRETE OR MASONRY WALLS WITH A MINIMUM THICKNESS LESS THAN OR EQUAL TO 8 IN L = FRAMED WALLS	0000 - 0999 BLANK OPENINGS 1000 - 1999 METAL PIPE, CONDUIT OR TUBING 2000 - 2999 NON METALLIC PIPE CONDUIT OR TUBING 3000 - 3999 CABLES 4000 - 4999 CABLE TRAYS 5000 - 5999 INSULATED PIPES 6000 - 6999 MISCELLANEOUS ELECTRICAL (BUSWAY) 7000 - 7999 MISCELLANEOUS MECHANICAL 8000 - 8999 MIXED PENETRATING ITEMS 9000 - 9999 RESERVED FOR FUTURE USE	C = FLOOR OR WALLPENETRATION A = CONCRETE FLOORS 5" OR LESS J = CONCRETE OR MASONRY WALLS 8" OR LESS 1150 = METAL PIPE, CONDUIT OR TUBING

Joint Systems

First letters identify the type of joint:	Second letter(s) provide more information about the floor or wall:	Four digit number describes the penetrating item(s)	Example: HWD0757
CJ = CONTINUITY HEAD OF WALL FF = FLOOR TO FLOOR WW = WALL TO WALL FW = FLOOR TO WALL HW = HEAD TO WALL BW = BOTTOM OF WALL	S = NO MOVEMENT (STATIC) D = ALLOWS MOVEMENT (DYNAMIC)	0000 - 0999 LESS THAN OR EQUAL TO 2" 1000 - 1999 GREATER THAN 2" AND LESS THAN OR EQUAL TO 6" 2000 - 2999 GREATER THAN 6" AND LESS THAN OR EQUAL TO 12" 3000 - 3999 GREATER THAN 12" AND LESS THAN OR EQUAL TO 24" 4000 - 4999 GREATER THAN 24"	HW = HEAD TO WALL D = ALLOWS MOVEMENT (DYNAMIC) 0757 = LESS THAN OR EQUAL TO 2"

Notes:

- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - 22 00 00 Plumbing
 - 23 00 00 HVAC
 - 26 00 00 Electrical
 - 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - Fire Rating (F-Rating)
 - Temperature Rating (T-Rating)
 - Leakage Rating (L-Rating)
 - Water Rating (W-Rating)
 - Annular Space
 - Percent Fill
 - Movement
 - Type and thickness of fire-rated construction.
- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - NFPA 101 Life Safety Code
 - NFPA 70 – National Electric Code
 - All governing local and regional building codes.

5. Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - Warning! - Do Not Disturb
 - Through Penetration Firestop System
 - UL System # * Product(s) used
 - Hourly Rating (F-Rating)
 - Installation Date
 - Contractor's Name

7. For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriter's Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: _____

DRAWN: _____






CHECKED: _____

ISSUE DATE: 01-25-2018

REVISIONS: _____

SHEET NAME: _____
Index of Drawings

SHEET NUMBER: _____

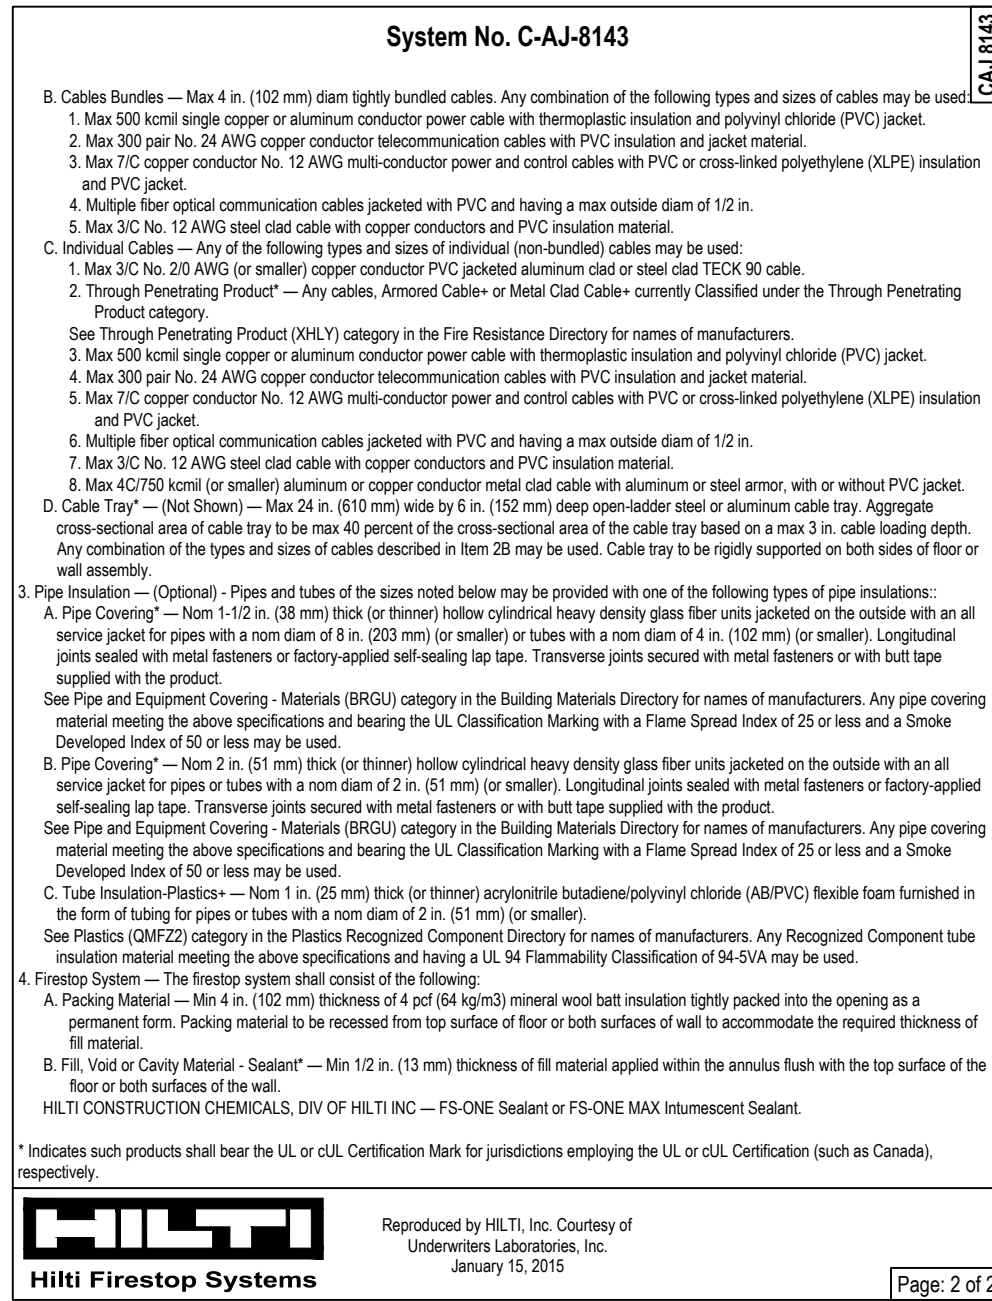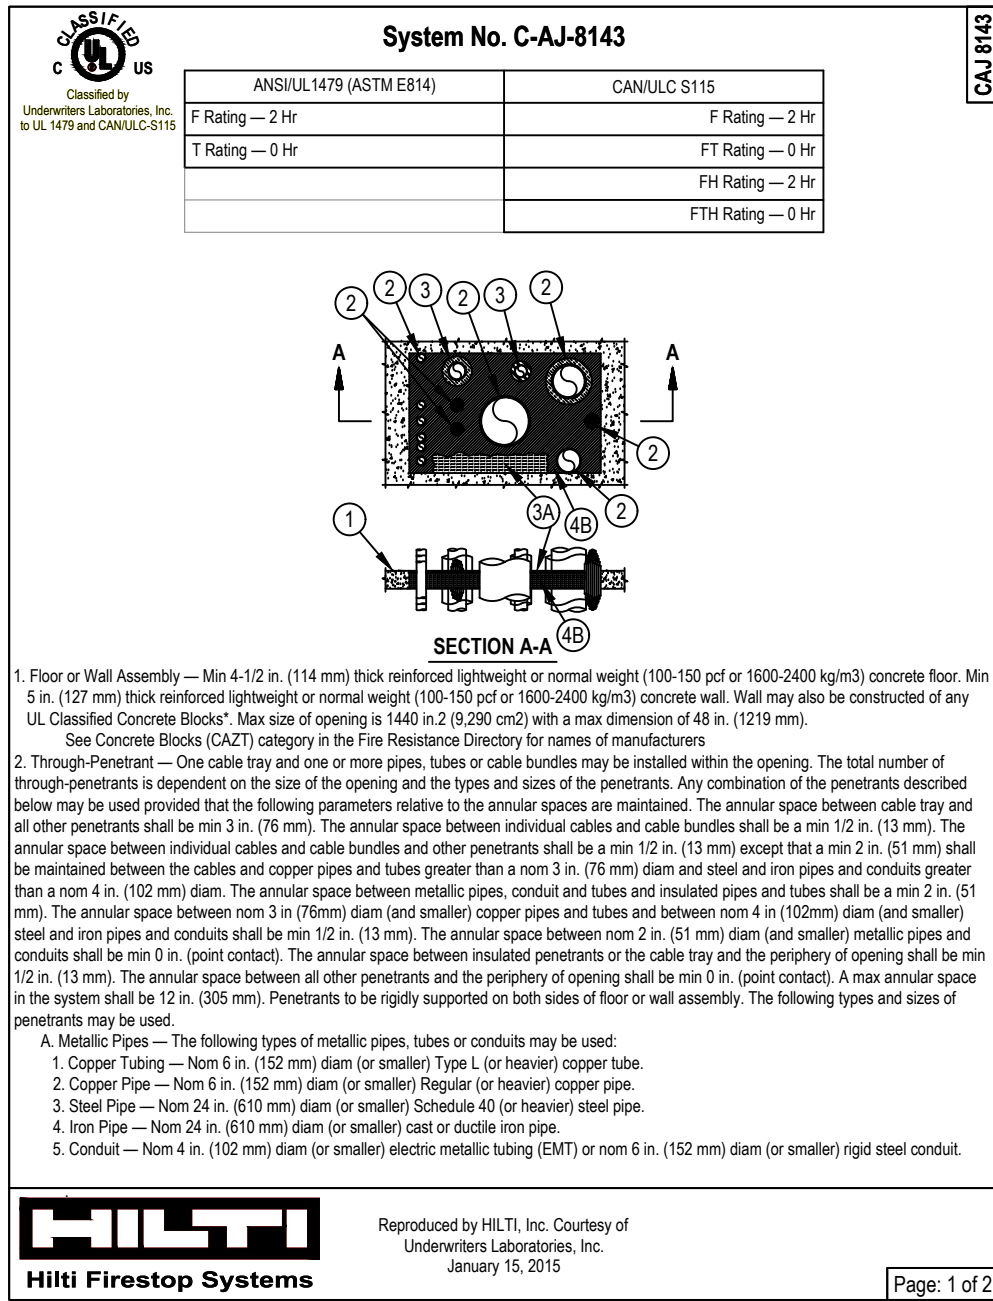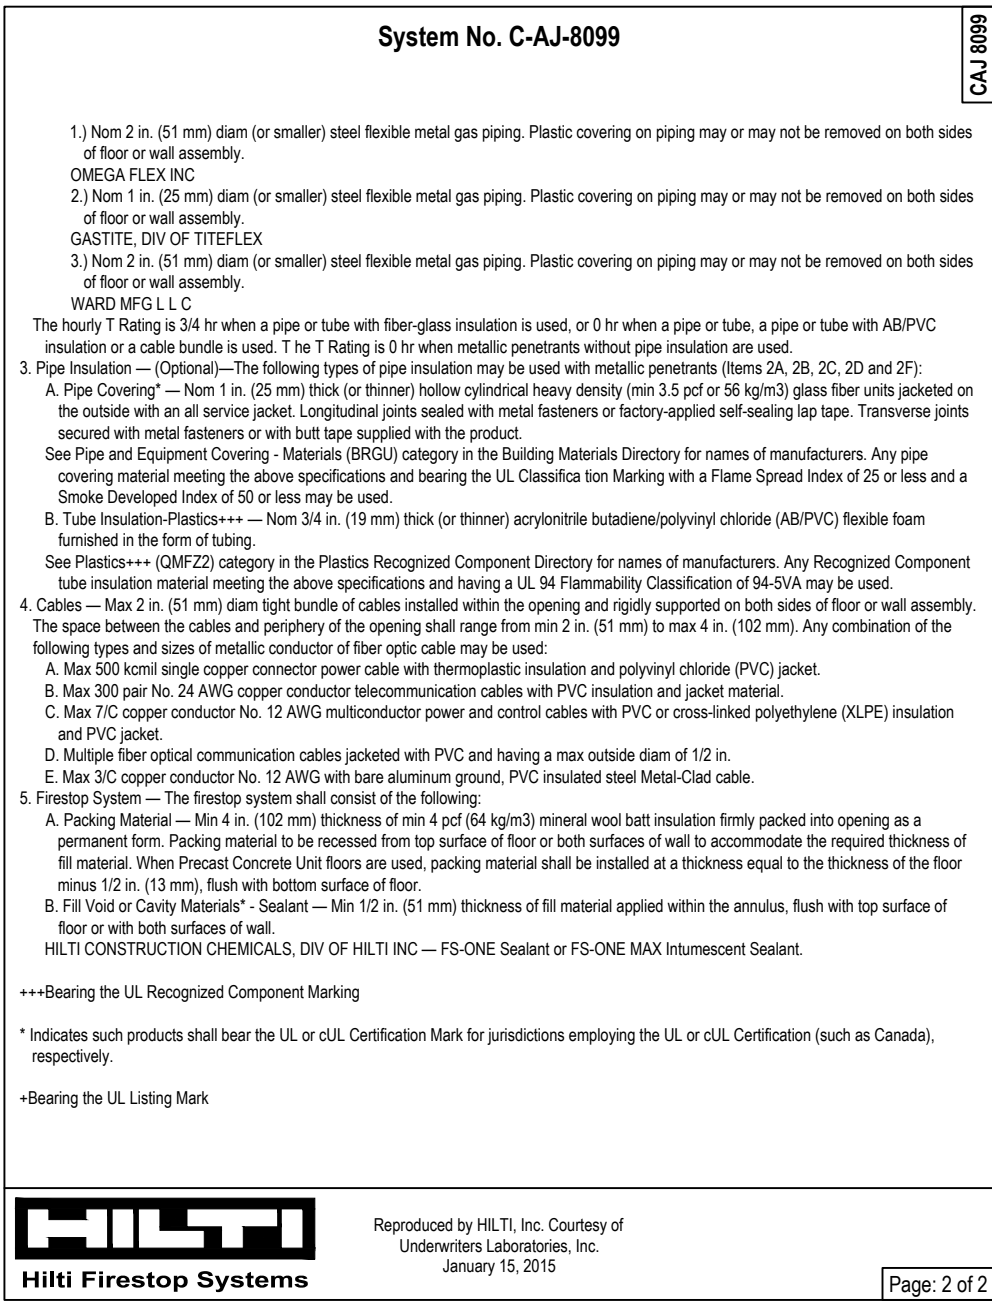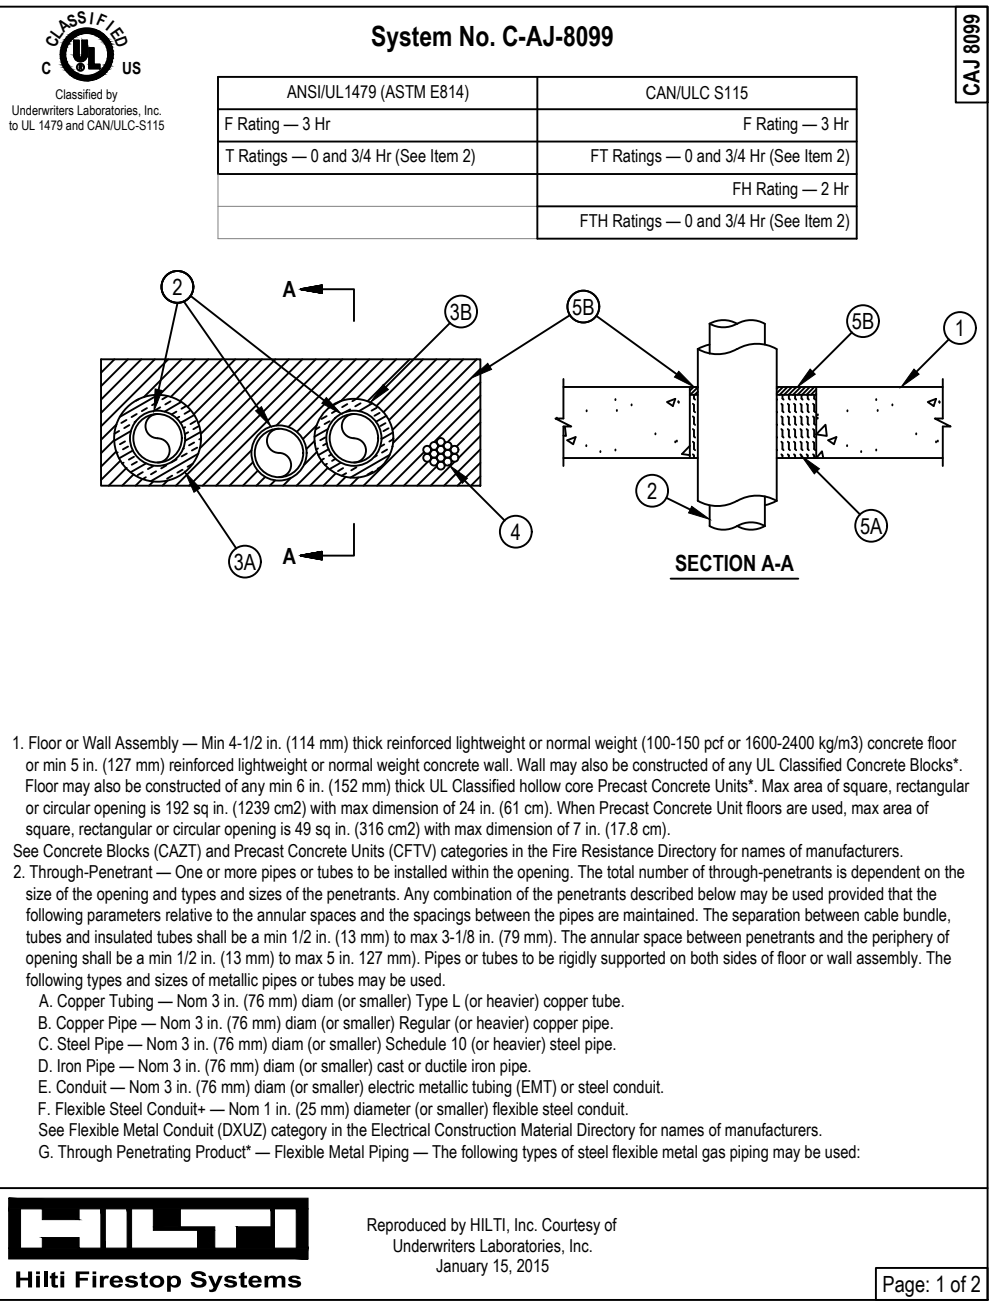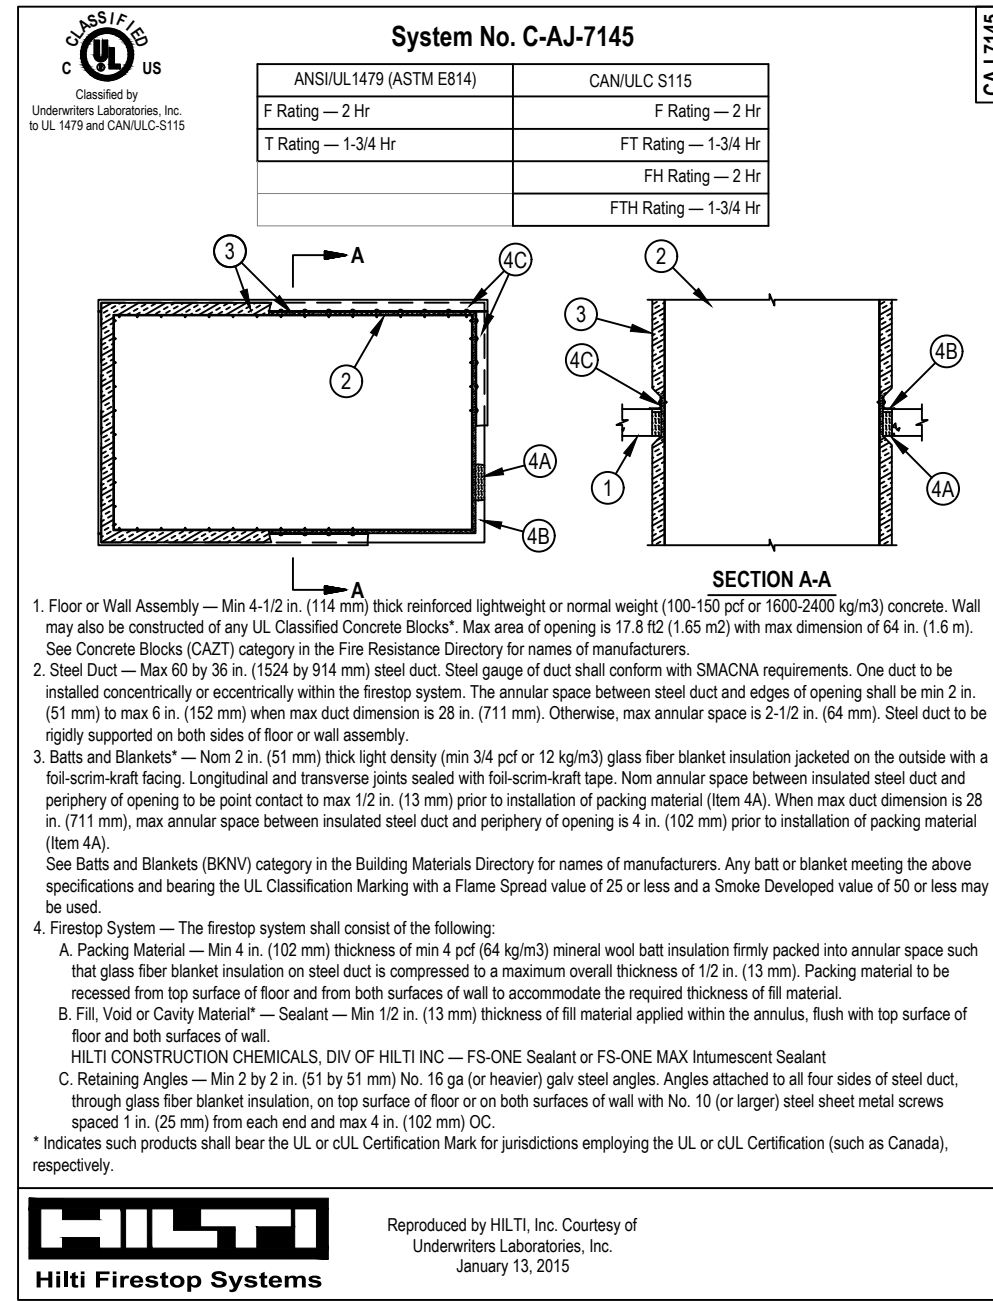

Hilti Firestop Systems
Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc.
January 15, 2015

Hilti Firestop Systems
Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc.
January 15, 2015

Hilti Firestop Systems
Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc.
January 15, 2015

Hilti Firestop Systems
Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc.
January 15, 2015

Hilti Firestop Systems
Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc.
January 15, 2015

<Notes to designer (delete this note after reading and replace with title block information)>
1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
2. Details shown are up to date as of February 2015.
3. For additional information on the details, refer to the most current 'Underwriters Laboratories Fire Resistance Directory (volume 2)'

- Notes:
- Refer to the following specifications for firestopping.
 - a. 07 84 00 Firestopping
 - b. 07 84 13 Penetration Firestopping
 - c. 07 84 43 Joints Firestopping
 - d. 22 00 00 Plumbing
 - e. 23 00 00 HVAC
 - f. 26 00 00 Electrical
 - g. 27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1797) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

JOB NUMBER:
DRAWN:
CHECKED:
ISSUE DATE: 01-25-2018
REVISIONS:
SHEET NAME:
Healthcare - Concrete Over Metal Deck-Gypsum Walls.
SHEET NUMBER:

Wall Opening Protective Materials (CLIV, CLIV7)

Power Cable
1/8" Thick CP617 or CP5-P-PA Firestop Putty Pad
Wood Stud or Steel Stud (Not Shown)
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 1 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

1 or 2-Hr Gypsum Wall Assembly (2-Hr Show)
Steel Stud or Wood Stud (Not Shown)
Power Cable
Firestop Box Insert
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 2 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

1 or 2-Hr Gypsum Wall Assembly (2-Hr Show)
Steel Stud or Wood Stud (Not Shown)
Power Cable
Firestop Box Insert
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 3 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

1 or 2-Hr Gypsum Wall Assembly (2-Hr Show)
Steel Stud or Wood Stud (Not Shown)
Power Cable
Firestop Box Insert
UL Listed Non-Metallic Outlet Box (Refer to UL Listing) Or UL Listed Metallic Outlet Box (Refer to UL Listing)

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 4 of 5

Wall Opening Protective Materials (CLIV, CLIV7)

Box Size	Type of Box and Cover Plate	Hourly Rating	Inset Type
4 x 4 x 2-1/8 in. deep	Metallic w/ steel cover plates	2-hour	UL300, UL400 or V400 - wood or steel studs
4 x 4 x 2-1/8 in. deep	Metallic w/ plastic cover plates	1-hour	UL300, UL400 or V400 - wood or steel studs
4 x 4 x 1-1/2 in. deep	Metallic w/ plastic cover plates	1-hour	UL300 - wood studs

Reproduced by Hilti, Inc. Courtesy of Underwriters Laboratories, Inc. December 07, 2018. Page 5 of 5

Notes:

- Refer to the following specifications for firestopping.
 - 07 84 00 Firestopping
 - 07 84 13 Penetration Firestopping
 - 07 84 43 Joints Firestopping
 - d.22 00 00 Plumbing
 - e.23 00 00 HVAC
 - f.26 00 00 Electrical
 - g.27 05 37 Communication Systems

For Quality Control requirements, refer to the Quality Control portion of the specification.

- Details shown are typical details. Always refer to the listed system detail for complete system requirements. If field conditions do not match requirements of details, approved alternate details shall be utilized. Design requirements, field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 - * Fire Rating (F-Rating)
 - * Temperature Rating (T-Rating)
 - * Leakage Rating (L-Rating)
 - * Water Rating (W-Rating)
 - * Annular Space
 - * Percent Fill
 - * Movement
 - * Type and thickness of fire-rated construction.

- If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable subject to approval by the Authority Having Jurisdiction (AHJ). Contact Hilti Inc. for alternative systems or Engineering Judgment (800-879-8000). Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.

- References:
 - * 2017 Underwriter's Laboratories Fire Resistance Directory, Volumes 1 & 2.
 - * NFPA 101 Life Safety Code
 - * NFPA 70 – National Electric Code
 - * All governing local and regional building codes.

- Firestop System installation must meet requirements of ASTM E-814 (UL 1479) tested assemblies that provide a fire rating equal or greater to that of construction being penetrated.

- All rated through-penetration assemblies shall be prominently labeled with a Hilti Firestop Label equipped with a QR code with the following information.
 - * Warning! - Do Not Disturb
 - * Through Penetration Firestop System
 - * UL System # * Product(s) used
 - * Hourly Rating (F-Rating)
 - * Installation Date
 - * Contractor's Name

- For outlet boxes requiring protection, use only Wall Opening Protective Materials, Category CLIV as classified by Underwriter's Laboratories, Fire Resistance Directory (Volume 1).

Current as of November 19, 2017. System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current 'Underwriter's Laboratories Fire Resistance Directory (volume 2)'.

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 01-25-2018

REVISIONS: _____

SHEET NAME: Healthcare - Concrete Over Metal Deck - Membrane Penetration

SHEET NUMBER: _____

System No. HW-D-0081
Assembly Rating - 2 Hr
Nominal Joint Width - 3/4 in.
Class II Movement Capabilities - 33% Compression or Extension

1. Floor Assembly — The fire-rated fused steel floor anticorrosive floor assembly shall be constructed of the materials and in the manner described in the individual 1200 or 1500 Floor Ceiling Design in the Fire Resistance Directory and shall include the following construction features:
A. Steel Floor and Form Units — Max 3/8 in. deep galv steel fused floor units.
B. Concrete — Min 2 1/4 in. thick unreinforced concrete, as measured from the top plane of the floor units.
1A. Roof Assembly — (Not Shown) — As an alternate to the floor assembly, a fire-rated fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual 1900 Series Roof Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
A. Steel Roof Deck — Max 3/8 in. deep galv steel fused roof deck.
B. Roof Insulation — Min 2 1/4 in. thick poured insulating concrete, as measured from the top plane of the floor units.
2. Wall Assembly — Min 5 in. thick steel reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of an UL Classified Concrete Block.
 See Concrete Block (CA27) category in the Fire Resistance Directory for names of manufacturers.

3. Joint System — Max separation between bottom of floor or roof and top of wall is 3/4 in. The joint system is designed to accommodate a max 33 percent compression or extension from its installed width. The joint system consists of a packing material and a fill material between the top of the wall and the bottom of the floor or roof, as follows:
Configuration
A. Forming Material — Min 4 in. thickness of a pfd density mineral wool batt insulation was cut to the shape of the fused deck, approximately 20 percent larger than the area of the flange and compressed into the flange of the steel deck above the wall assembly. The forming material shall be recessed 1/2 in. from each side of the wall. Additional pieces of forming material, compressed min 50 percent in thickness and installed edge to edge with joint spacing between bottom of steel deck and top of wall, parallel with joint direction. Compressed batt sections recessed 1/2 in. from both wall surfaces. Adjoining lengths of batt to be tightly butted with butted seams spaced min 48 in. apart along the length of the joint.
INSULATION SYSTEMS — (Not Shown)
A1. Forming Material — (Optional-Not Shown) Performed mineral wool plugs, formed to the shape of the fused deck. Section fit to completely fill the flange. The plugs shall be recessed 1/2 in. from both wall surfaces. Additional forming material, described in item 3A, to be used in conjunction with the plugs to fill the gaps between the top of the wall and bottom of steel deck.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP777 Speed Plug
B. Fill Void or Cavity Material — Sealant — Min 1/2 in. thickness of fill material installed on each side of the wall in the flange of the steel deck and between the top of the wall and the bottom of the steel deck, flush with each surface of the wall.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP606 Flexible Firestop Sealant
Configuration
A. Forming Material — Min 4 in. thickness of a pfd density mineral wool batt insulation compressed min 50 percent in thickness and installed edge to edge with joint spacing between bottom of steel deck and top of wall, parallel with joint direction. Compressed batt sections recessed 1/2 in. from both wall surfaces. Adjoining lengths of batt to be tightly butted with butted seams spaced min 48 in. apart along the length of the joint.
INSULATION SYSTEMS — (Not Shown)
B. Fill Void or Cavity Material — Sealant — Min 1/2 in. thickness of fill material installed on each side of the wall between the top of the wall and the bottom of the steel deck. Flush with each surface of the wall.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP606 Flexible Firestop Sealant
 Showing the U.S. Classification Mark.

UL
 Underwriters Laboratories, Inc.
 3601 Market Street, Chicago, IL 60642

Reproduced by HETI, Inc. Courtesy of Underwriters Laboratories, Inc. April 15, 2009

HIT Firestop Systems

Page: 1 of 2

System No. HW-D-0081
Assembly Rating - 2 Hr
Nominal Joint Width - 3/4 in.
Class II Movement Capabilities - 33% Compression or Extension

1. Floor Assembly — The fire-rated fused steel floor anticorrosive floor assembly shall be constructed of the materials and in the manner described in the individual 1200 or 1500 Floor Ceiling Design in the Fire Resistance Directory and shall include the following construction features:
A. Steel Floor and Form Units — Max 3/8 in. deep galv steel fused floor units.
B. Concrete — Min 2 1/4 in. thick unreinforced concrete, as measured from the top plane of the floor units.
1A. Roof Assembly — (Not Shown) — As an alternate to the floor assembly, a fire-rated fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual 1900 Series Roof Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
A. Steel Roof Deck — Max 3/8 in. deep galv steel fused roof deck.
B. Roof Insulation — Min 2 1/4 in. thick poured insulating concrete, as measured from the top plane of the floor units.
2. Wall Assembly — Min 5 in. thick steel reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of an UL Classified Concrete Block.
 See Concrete Block (CA27) category in the Fire Resistance Directory for names of manufacturers.

3. Joint System — Max separation between bottom of floor or roof and top of wall is 3/4 in. The joint system is designed to accommodate a max 33 percent compression or extension from its installed width. The joint system consists of a packing material and a fill material between the top of the wall and the bottom of the floor or roof, as follows:
Configuration
A. Forming Material — Min 4 in. thickness of a pfd density mineral wool batt insulation was cut to the shape of the fused deck, approximately 20 percent larger than the area of the flange and compressed into the flange of the steel deck above the wall assembly. The forming material shall be recessed 1/2 in. from each side of the wall. Additional pieces of forming material, compressed min 50 percent in thickness and installed edge to edge with joint spacing between bottom of steel deck and top of wall, parallel with joint direction. Compressed batt sections recessed 1/2 in. from both wall surfaces. Adjoining lengths of batt to be tightly butted with butted seams spaced min 48 in. apart along the length of the joint.
INSULATION SYSTEMS — (Not Shown)
A1. Forming Material — (Optional-Not Shown) Performed mineral wool plugs, formed to the shape of the fused deck. Section fit to completely fill the flange. The plugs shall be recessed 1/2 in. from both wall surfaces. Additional forming material, described in item 3A, to be used in conjunction with the plugs to fill the gaps between the top of the wall and bottom of steel deck.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP777 Speed Plug
B. Fill Void or Cavity Material — Sealant — Min 1/2 in. thickness of fill material installed on each side of the wall in the flange of the steel deck and between the top of the wall and the bottom of the steel deck, flush with each surface of the wall.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP606 Flexible Firestop Sealant
Configuration
A. Forming Material — Min 4 in. thickness of a pfd density mineral wool batt insulation compressed min 50 percent in thickness and installed edge to edge with joint spacing between bottom of steel deck and top of wall, parallel with joint direction. Compressed batt sections recessed 1/2 in. from both wall surfaces. Adjoining lengths of batt to be tightly butted with butted seams spaced min 48 in. apart along the length of the joint.
INSULATION SYSTEMS — (Not Shown)
B. Fill Void or Cavity Material — Sealant — Min 1/2 in. thickness of fill material installed on each side of the wall between the top of the wall and the bottom of the steel deck. Flush with each surface of the wall.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP606 Flexible Firestop Sealant
 Showing the U.S. Classification Mark.

UL
 Underwriters Laboratories, Inc.
 3601 Market Street, Chicago, IL 60642

Reproduced by HETI, Inc. Courtesy of Underwriters Laboratories, Inc. April 15, 2009

HIT Firestop Systems

Page: 2 of 2

System No. HW-D-1037
Assembly Rating - 2 Hr
Nominal Joint Width - 3/4 in.
Class II Movement Capabilities - 14% Compression and Extension

1. Floor Assembly — The fire-rated fused steel floor anticorrosive floor assembly shall be constructed of the materials and in the manner described in the individual Floor Ceiling Design in the Fire Resistance Directory and shall include the following construction features:
A. Steel Floor and Form Units — Max 3/8 in. deep galv steel fused floor units.
B. Concrete — Min 2 1/4 in. thick unreinforced concrete, as measured from the top plane of the floor units.
C. Spray Applied Fire Resistive Material — (Optional-Not Shown)—Prior to the installation of the forming material and fill, void or cavity material (Items 3A, 3B) the steel floor units may be sprayed with a min 5/16 in. (8 mm) to max 1/4 in. (4 mm) thickness of the resistive material.
INSULATION SYSTEMS — (Not Shown)
1A. Roof Assembly (Not Shown) — As an alternate to the floor assembly, a fire-rated fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual 1900 Series Roof Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
A. Steel Roof Deck — Max 3/8 in. (8 mm) deep galv steel fused roof deck.
B. Roof Insulation — Min 2 1/4 in. (57 mm) thick poured insulating concrete, as measured from the top plane of the floor units.
1B. Roof Assembly — As an alternate to Item 1 and 1A, a fire-rated protected fused steel deck roof assembly may be used. The roof assembly shall be constructed of the materials and in the manner described in the individual 1900 Series Roof Ceiling Design in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
A. Steel Roof Deck — Max 3/8 in. (8 mm) deep galv steel fused roof deck.
B. Spray Applied Fire Resistive Material — (Not Shown)—Prior to the installation of the steel ceiling system, Forming Material and Fill, Void or Cavity Material (Items 3A, 3B, 3C) the roof assembly shall be sprayed with the type and thickness of fire resistive material indicated in the individual 1900 Series Design.
2. Wall Assembly — Min 5 in. (127 mm) thick steel reinforced lightweight or normal weight (100-150 pcf) (1800-2400 kg/m³) structural concrete. Wall may also be constructed of any UL Classified Concrete Block.
 See Concrete Block (CA27) category in the Fire Resistance Directory for names of manufacturers.

UL
 Underwriters Laboratories, Inc.
 3601 Market Street, Chicago, IL 60642

Reproduced by HETI, Inc. Courtesy of Underwriters Laboratories, Inc. December 14, 2012

HIT Firestop Systems

Page: 1 of 2

System No. HW-D-1037
Assembly Rating - 2 Hr
Nominal Joint Width - 3/4 in.
Class II Movement Capabilities - 14% Compression and Extension

3. Joint System — Max separation between bottom of floor units and top of concrete wall at time of installation is 3/4 in. (19 mm). The joint system is designed to accommodate a max 14 percent compression or extension from its installed width. The joint system shall consist of the following:
A. Forming Material — Nom 4 in. (102 mm) thick pieces of normal pfd (84 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to completely fill the flange. Additional pieces of steel insulation, min 1/4 in. (20 mm) wide, shall be compressed 50 percent in thickness and installed edge to edge with joint spacing between bottom of fused floor or roof units and top of concrete wall.
INSULATION SYSTEMS — (Not Shown)
A1. Forming Material — (Optional-Not Shown) Performed mineral wool plugs, formed to the shape of the fused floor units. Section fit to completely fill the flange above the ceiling runner. The plugs shall be flush with both wall surfaces. Additional forming material, described in item 3A, to be used in conjunction with the plugs to fill the gaps between the top of the wall and the bottom of the steel floor units.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP777 Speed Plug
A2. Forming Material — As an alternate to Item 3A, min 1/4 pfd (84 kg/m³) ceramic fiber insulation installed in joint as a permanent form. Nominal 4 in. (102 mm) thick pieces of normal pfd (84 kg/m³) forming material used to attain a min compression rate of 50 percent in the thickness direction (only applied to completely fill the flange. Additional pieces of steel insulation, min 1/4 in. (20 mm) wide, shall be compressed 50 percent in thickness and installed edge to edge with joint spacing between bottom of fused floor or roof units and top of concrete wall.
B. Fill Void or Cavity Material — Sealant — A 1/8 in. (3.2 mm) wide thickness of fire resistive material on each side of wall to completely cover mineral wool forming material and to overlap a min 1/2 in. (13 mm) onto steel floor units and concrete wall. When spray applied the sealant material is applied to the steel deck, the fill material is to overlap the wall a min 1/4 in. and the spray applied fire resistive material a min of 2 in. (51 mm) on both sides of the wall.
HELIX CONSTRUCTION CHEMICALS, DIV OF HELTI INC. — CP622 Firestop Spray or CP15P WB Firestop, Joint Spray
 Showing the U.S. Classification Mark.

UL
 Underwriters Laboratories, Inc.
 3601 Market Street, Chicago, IL 60642

Reproduced by HETI, Inc. Courtesy of Underwriters Laboratories, Inc. December 14, 2012

HIT Firestop Systems

Page: 2 of 2

Notes:

1. Refer to section 07840 of the specifications. For Quality Control requirements, refer to the Quality Control portion of the specification.
2. Details shown are typical details. If field conditions do not match requirements of typical details, approved alternate details shall be utilized. Field conditions and dimensions need to be verified for compliance with the details, including but not limited to the following:
 * Minimum and maximum Width of Joints
 * Type and thickness of fire-rated construction. The minimum assembly rating of the firestop assembly shall meet or exceed the highest rating of the adjacent construction.
 * If alternate details matching the field conditions are not available, manufacturer's engineering judgment drawings are acceptable. Drawings shall follow the International Firestop Council (IFC) Guidelines for Evaluating Firestop Systems Engineering Judgments.
3. References:
 * 2017 Underwriter's Laboratories Fire Resistance Directory, Volume 2
 * Intertek Directory of Building Products
 * All governing local and regional building codes

Current as of November 19, 2017.
 System details subject to change without notice.

<Notes to designer (delete this note after reading and replace with title block information)>
 1. Any modification to these details could result in an application/system not meeting the UL or Intertek Classification or the intended temperature or fire ratings.
 2. Details shown are up to date as of February 2015.
 3. For additional information on the details, refer to the most current Underwriters Laboratories Fire Resistance Directory (volume 2.)

JOB NUMBER: _____

DRAWN: _____

CHECKED: _____

ISSUE DATE: 01-25-2018

REVISIONS: _____

SHEET NAME:
 Healthcare - Concrete Over Metal Deck - Concrete or Masonry Wall

SHEET NUMBER: _____